

Neles™ V-port segment valves

Series R

Installation, maintenance and
operating instructions

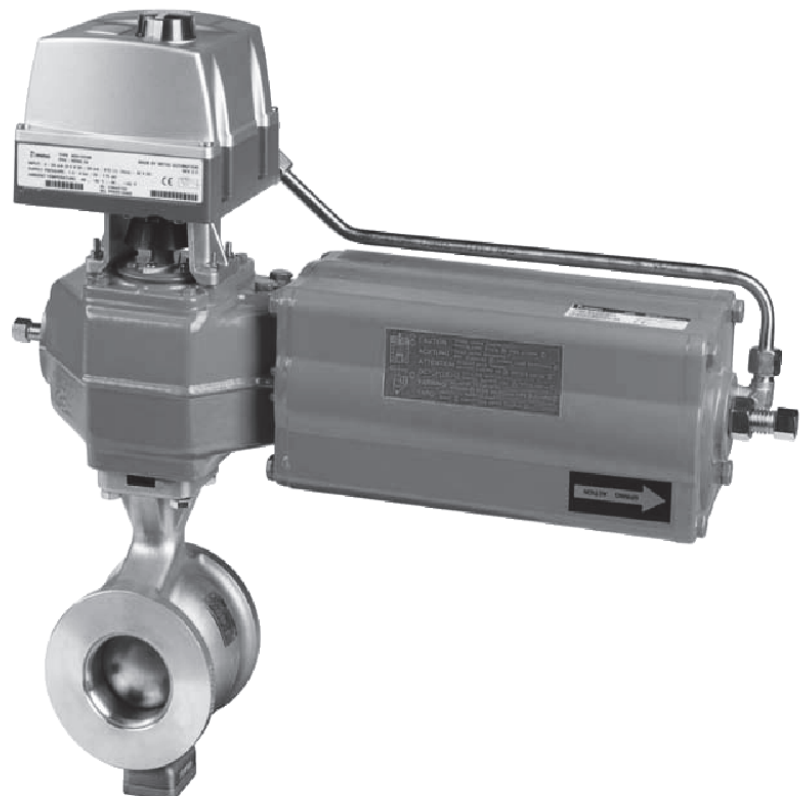


TABLE OF CONTENTS

GENERAL	3	TROUBLE SHOOTING	15
Scope of the manual	3	TABLE	
Valve construction	3	TOOLS	15
Valve markings	3	ORDERING SPARE PARTS	15
Technical specifications	4	EXPLODED VIEWS	16
Valve approvals	6	AND PARTS LISTS	
CE marking	6	Series RA	16
Recycling and disposal	6	Series RE	17
Safety precautions	6	DIMENSIONS AND	18
Welding notes	6	WEIGHTS	
TRANSPORTATION,	7	Series RA	18
RECEPTION AND		RA-B1C	19
STORAGE		RA - B1J, B1JA	20
INSTALLATION	7	RA - M	21
General	7	Series RE	22
Installing in the pipeline	7	RE - B1C	23
Actuator	7	RE - B1J, B1JA	24
COMMISSIONING	8	RE - QPX	25
MAINTENANCE	8	Suitability with different flanges,	
Maintenance general	8	RA and RE1 valves	26
Replacing the gland packing	8	Flange ratings, RE (Class 150, 300)	26
Detaching the actuator	9	TYPE CODE	27
Removing the valve from the pipeline	9	Series RA	27
Replacing the seat	10	Series RE, RE1	28
Dismantling the valve	11		
Inspection of removed parts	12		
Assembly	12		
TESTING THE VALVE	13		
INSTALLING AND			
DETACHING THE			
ACTUATORS	13		
General	13		
Installing B1C actuators	13		
Installing B1J actuators	14		
Detaching B series actuators	14		
Installing a Quadra-Powr™ actuator	14		

Subject to change without notice.

All trademarks are property of their respective owners.

READ THESE INSTRUCTIONS FIRST!

These instructions provide information about safe handling and operation of the valve.

If you require additional assistance, please contact the manufacturer or manufacturer's representative.

SAVE THESE INSTRUCTIONS!

Addresses and phone numbers are printed on the back cover.

1 GENERAL

1.1 Scope of the manual

This manual provides essential information on R series V-port segment valves, i.e. RA, RE and RE1-series valves. Actuators and other accessories are only discussed briefly. Refer to the individual manuals for further information on their installation, operation and maintenance.

NOTE:

Selection and use of the valve in a specific application requires close consideration of detailed aspects. Due to the nature of the product, this manual cannot cover all the individual situations that may occur when the valve is used.

If you are uncertain about use of the valve or its suitability for your intended purpose, please contact Valmet for more information.

For valves in oxygen service, please see also the separate installation, maintenance and operating instructions for oxygen service (see Neles document id: 10O270EN.pdf).

1.2 Valve construction

RA, RE and RE1-series valves are V-port segment valves installed between flanges. RE series valves are flanged V-port segment valves. The body is in one part; the shaft and the segment are separate. Shaft blow-out is prevented by plates mounted against the shaft shoulder. See Figs. 1 and 2.

The valve is either soft or metal seated. Tightness derives from the spring force pressing the seat against the segment. The structure of the valve supplied may vary, depending on the customer's requirements. The detailed structure is revealed by the type code shown on the valve identification plate. The type code is explained in Section 15.

The valve is designed for both control and shut-off applications.

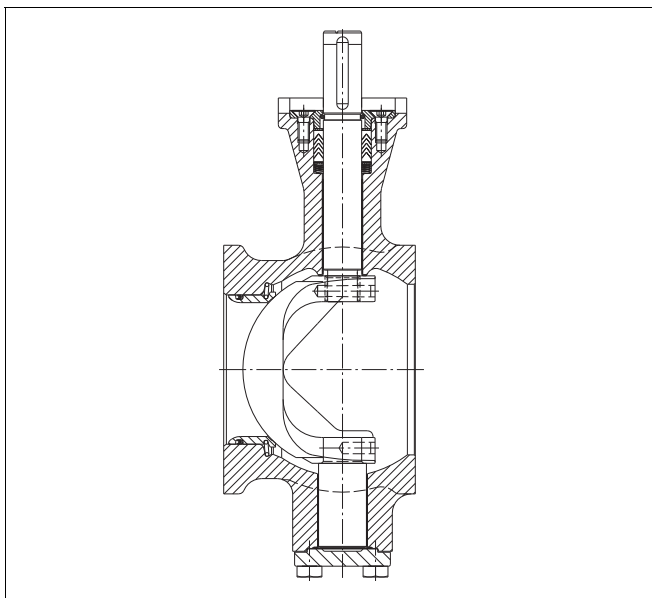


Fig. 1 Construction of a V-port segment valve, RA

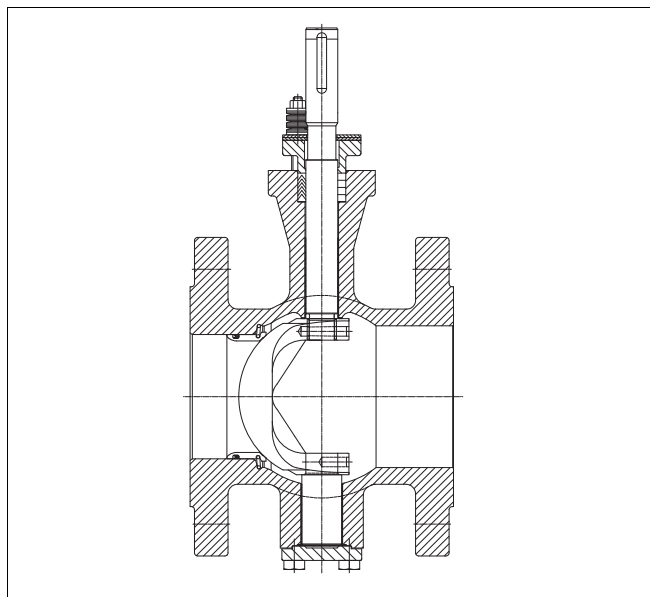


Fig. 2 Construction of a V-port segment valve, RE/RE1

1.3 Valve markings

Body markings are cast on the body. The valve also has an identification plate attached to it, see Fig. 3.

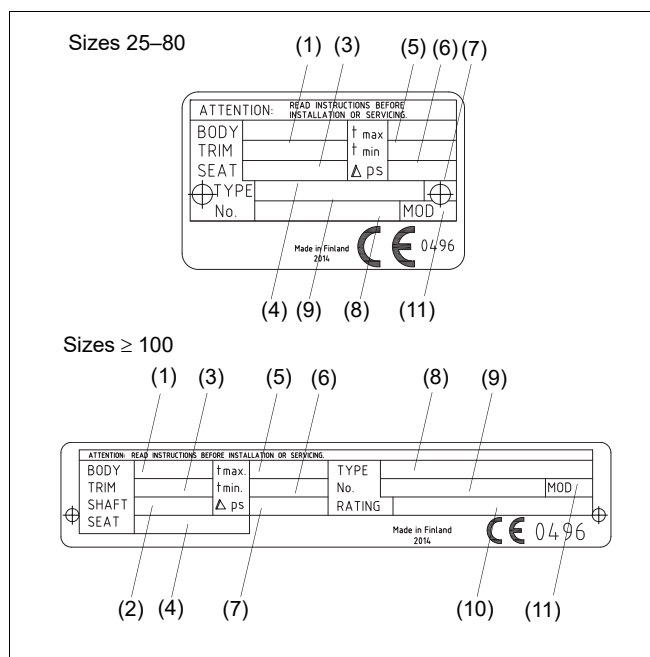


Fig. 3 Identification plate

Identification plate markings:

1. Body material
2. Shaft material
3. Segment material
4. Seat material
5. Maximum operating temperature
6. Minimum operating temperature
7. Maximum shut-off pressure differential
8. Type designation
9. Valve manufacturing parts list no.
10. Pressure class
11. Model

1.4 Technical specifications

Initial openings (%) for RE/RA segment valves with different seats.			
Size	Seat		
	S & A	1S	T2
25	14,2	12,8	24,1
C005 25/1	10.3	N/A	16.1
C015 25/2	10.3	N/A	16.1
C05 25/3	10.3	N/A	16.1
C15 25/4	10.3	N/A	16.1
40	11.9	9.3	18.6
50	16.7	11.4	21.1
65	12.6	10.6	16.8
80	8.9	7.8	14.1
100	8.1	7.0	14.1
150	7.0	5.6	12.2
200	6.2	5.9	11.4
250	6.1	5.6	9.7
300	5.6	5.0	9.0
350	5.2	5.4	8.6
400	5.1	4.4	8.2
500	4.4	4.4	7.1
600	N/A	5.9	N/A
700	N/A	6.3	N/A

Face-to-face length: RA: According to Neles internal standard
RE, RE1: acc. to IEC/EN 534-3-2

Body rating: RA: ASME Class 300 or PN 40
RE, RE1: ASME Class 300 or PN 50/PN40
NPS 1"-4" has option of ASME Class 600 or PN 63/PN 100

Max. pressure differential: see Figs. 6 ... 12

Temperature ranges:

RA-series:

-40 °C... +260 °C.

RE-series:

-50 °C ... +260 °C with soft bearings

-50 °C ... +315 °C with metal bearings
in sizes 2" - 10"

-50 °C ... +425 °C with metal bearing and high temperature seats in sizes 2" - 10".

Flow direction: indicated by an arrow on the body

Dimensions: see Section 11

Weights: see Section 11

Note that max. shut-off and max. throttling pressures are based on mechanical maximum differential pressures at ambient temperature. You must always observe flowing temperature and flange rating when concluding applicable pressure values. In practice you must also check noise level, cavitation intensity, velocity, actuator load factor, etc. using Nelprof.

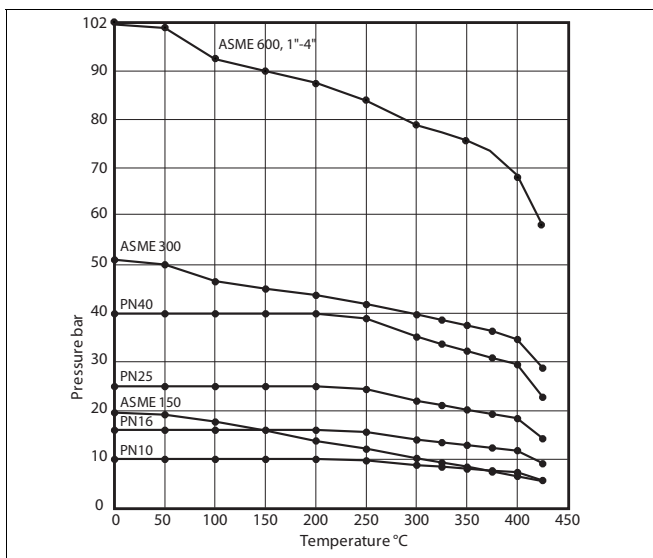


Fig. 4 Body pressure ratings, WCB

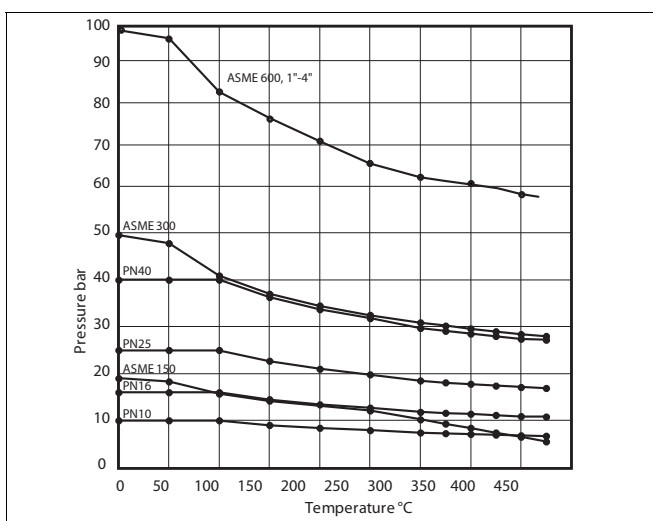


Fig. 5 Body pressure ratings, CF8M

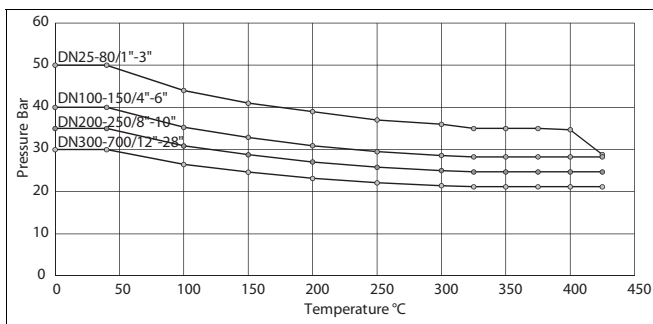


Fig. 6 Max operating pressure differential in control service, RE opening range 0 %-70 %

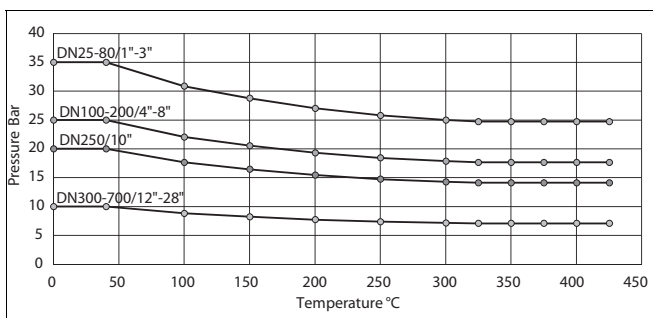


Fig. 7 Max operating pressure differential in control service, RE opening range 70 %-100 %

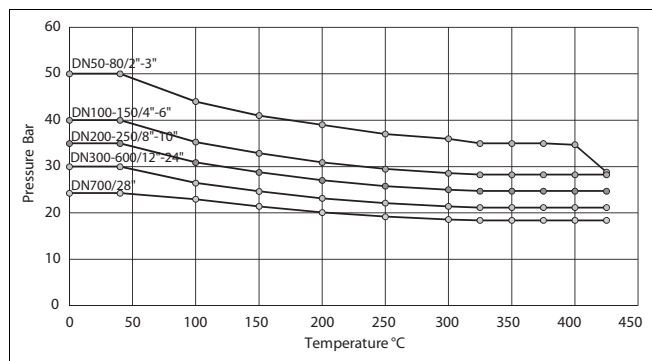


Fig. 8 Max operating pressure differential in control service, Q-RE opening range 0 %-30 %

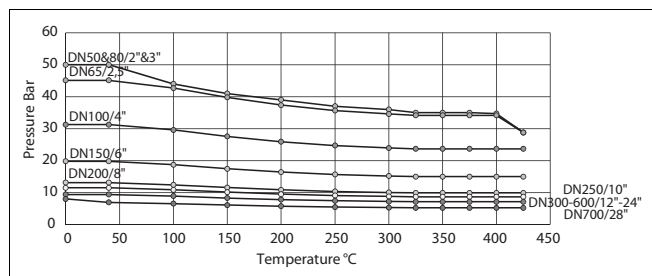


Fig. 9 Max operating pressure differential in control service, Q-RE opening range 30 %-60 %

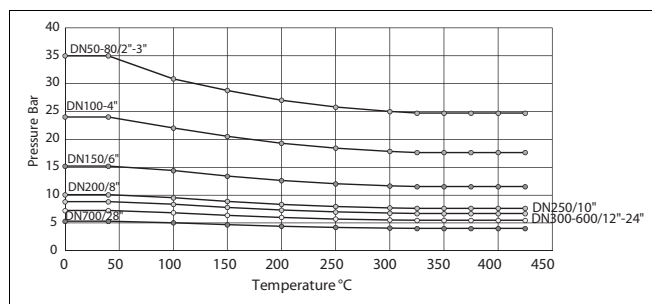


Fig. 10 Max operating pressure differential in control service, Q-RE opening range 60 %-100 %

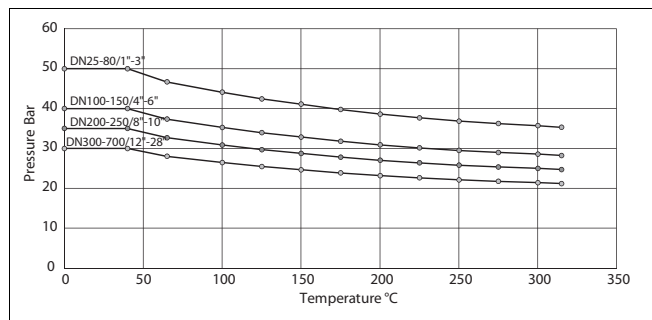


Fig. 11 Maximum pressure differentials in on-off operation, AISI 329 Shaft

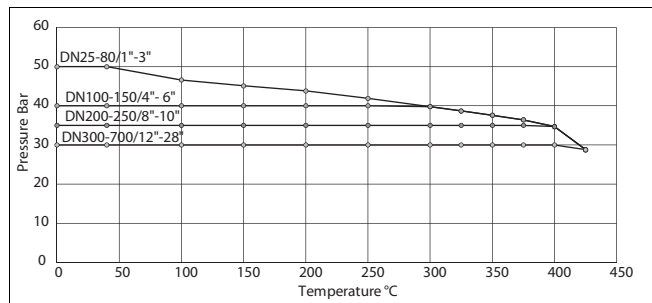


Fig. 12 Maximum pressure differentials in on-off operation, 17-4PH Shaft

1.5 Valve approvals

Valve meets the Fire safe requirements of ISO 10497:2010 - API 607, seventh edition.

1.6 CE marking

The valve meets the requirements of the European Directive 2014/68/EU relating to pressure equipment, and has been marked according to the Directive.

1.7 Recycling and disposal

Most valve parts can be recycled if sorted according to material. Most parts have material marking. A material list is supplied with the valve. In addition, separate recycling and disposal instructions are available from the manufacturer. A valve can also be returned to the manufacturer for recycling and disposal against a fee.

1.8 Safety precautions

CAUTION:

Do not exceed the valve performance limitations!

Exceeding the limitations marked on the valve may cause damage and lead to uncontrolled pressure release. Damage or personal injury may result.

CAUTION:

Do not dismantle the valve or remove it from the pipeline while the valve is pressurized!

Dismantling or removing a pressurized valve will result in uncontrolled pressure release. Always isolate the relevant part of the pipeline, release the pressure from the valve and remove the medium before dismantling the valve.

Be aware of the type of medium involved. Protect yourself and the environment from any harmful or poisonous substances. Make sure that no medium can enter the pipeline during valve maintenance.

Failure to do this may result in damage or personal injury.

CAUTION:

Beware of the segment movement!

Keep hands, other parts of the body, tools and other objects out of the open flow port. Leave no foreign objects inside the pipeline. When the valve is actuated, the segment functions as a cutting device. The segment position may also change when the valve is moved. Close and detach the actuator pressure supply pipeline for valve maintenance. Failure to do this may result in damage or personal injury.

CAUTION:

Protect yourself from noise!

The valve may produce noise in the pipeline. The noise level depends on the application. It can be measured or calculated using the Neles Nelprof software. Observe the relevant work environment regulations on noise emission.

CAUTION:

Beware of a very cold or hot valve!

The valve body may be very cold or very hot during use. Protect yourself against cold injuries or burns.

CAUTION:

When handling the valve or the valve package, take its weight into account!

Never lift the valve or valve package by the actuator, positioner, limit switch or their piping.

Place the lifting ropes securely around the valve body (see Fig. 13). Damage or personal injury may result from falling parts.

CAUTION:

Make sure the valve is not pressurized when removing the actuator.

CAUTION:

Potential electrostatic charging hazard. Ensure the protection in the process.

1.9 Welding notes

WARNING:

Welding and/or grinding stainless steel and other alloys containing chromium metal may cause the release of hexavalent chromium. Hexavalent chromium(VI) or Cr(VI), is known to cause cancer. Be sure to use all appropriate personal protective equipment (PPE) when welding metals containing chromium.

NOTE:

A qualified welder must do the installation welding. The welder and welding procedure should be qualified in accordance with the ASME Boiler and Pressure Vessel Code Section IX or other applicable regulation.

CAUTION:

To prevent damage to the seat and seals, do not allow the temperature of the seat and body seal area to exceed 94 °C (200 °F).

It is recommended that thermal chalks be used to check the temperature in these areas during welding.

CAUTION:

Ensure that any weld splatter does not fall onto the valve closing members eg. ball or seats. This may damage critical seating surfaces and cause leaks.

2 TRANSPORTATION, RECEPTION AND STORAGE

Check the valve and the accompanying devices for any damage that may have occurred during transport.

Store the valve carefully before installation, preferably indoors in a dry place.

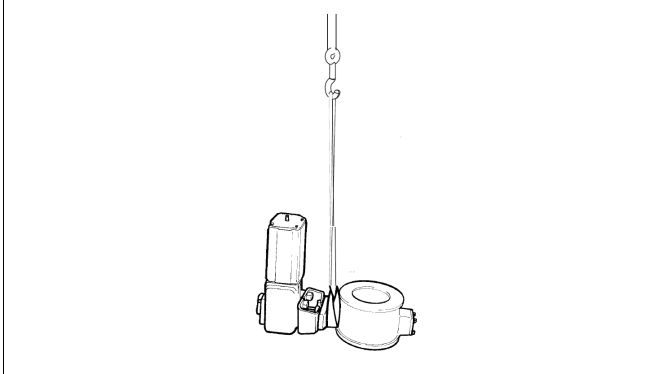


Fig. 13 Lifting the valve

Do not take the valve to the intended location and do not remove the flow port protectors until the valve is installed.

The valve is delivered in the closed position. A valve equipped with a spring-return actuator is delivered in the position determined by the spring.

3 INSTALLATION

3.1 General

Remove the flow port protectors and check that the valve is clean inside.

CAUTION:

When handling the valve or the valve package, take its weight into account!

3.2 Installing in the pipeline

Flush or blow the pipeline carefully before installing the valve. Foreign particles, such as sand or pieces of welding electrode, will damage the segment sealing surface and seats.

The valve has an arrow indicating the flow direction. Install the valve in the pipeline so that the flow direction of the pipe corresponds to that marked on the valve. The mounting position does not place restrictions on operation of the valve, actuator or positioner. You should, however, avoid installing the valve so that the shaft points downwards because impurities travelling in the pipeline may then enter the body cavity and damage the gland packing. See Fig. 14. The RA and RE1 valves should be applicable to the pipe flanges, see the chapter 11.19.

Choose flange gaskets according to the operating conditions.

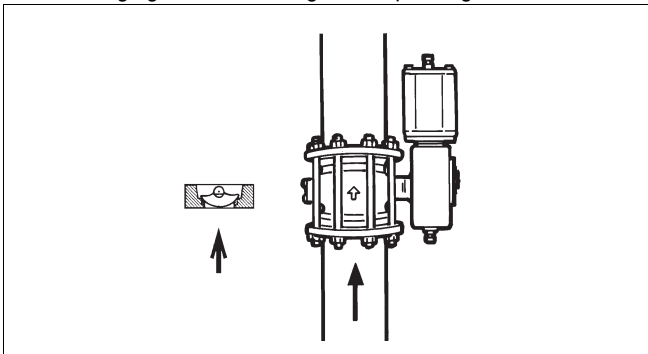


Fig. 14 Installing the valve into pipeline

Do not attempt to correct pipeline misalignment by means of flange bolting.

Stress caused in the valve by pipeline vibration can be reduced by supporting the pipeline properly. Reduced vibration also helps ensure correct functioning of the positioner.

Servicing is facilitated if the valve needs no support. If necessary, you can support the valve by the body, using regular pipe clamps and supports. Do not fasten supports to the flange bolting or the actuator, see Fig. 15.

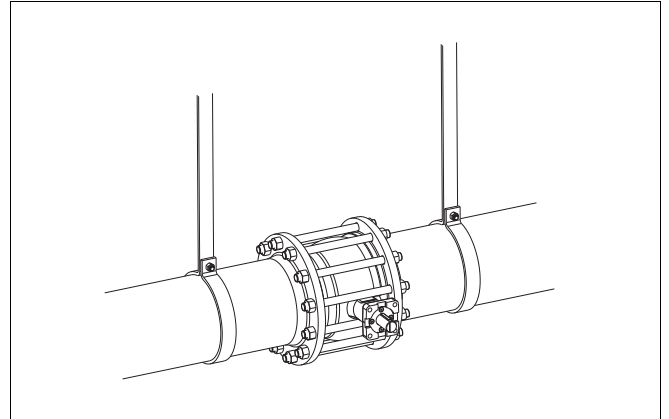


Fig. 15 Supporting the valve

3.3 Actuator

NOTE:

When installing the actuator, make sure that the valve-actuator combination functions properly. Detailed information on actuator installation is given in Section 6 or in separate actuator instructions.

The valve closed and open positions are indicated by a groove at the end of the valve shaft. The groove shows the position of the segment with respect to the flow port, see Fig. 16.

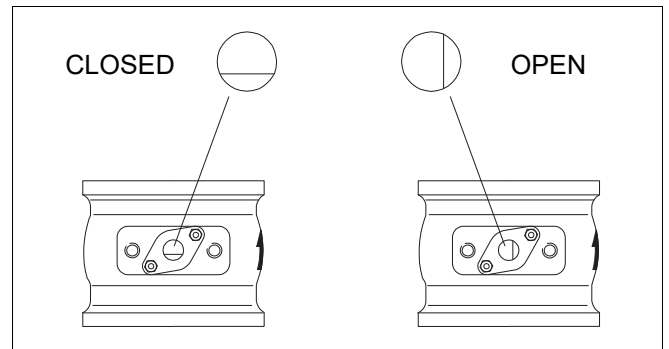


Fig. 16 Closed and open positions

If possible, install the valve so that the actuator can be disconnected without removing the valve from the piping.

The actuator must not touch the pipeline, because pipeline vibration may damage it or interfere with its operation.

In some cases, for instance when a large-size actuator is used or when the pipeline vibrates heavily, supporting the actuator is recommended. Contact Valmet for further information.

4 COMMISSIONING

Ensure that no dirt or foreign objects are left inside the valve or pipeline. Flush the pipeline carefully. Keep the valve entirely open during flushing.

Check all joints, pipings and cables.

Check that the actuator, positioner and limit switches are correctly adjusted. Refer to their installation, operation and service manuals.

5 MAINTENANCE

5.1 Maintenance general

CAUTION:

Observe the safety precautions mentioned in Section 1.8 before maintenance!

CAUTION:

When handling the valve or the valve package as a whole, bear in mind the weight of the valve or the entire package.

Although Neles valves are designed to work under severe conditions, proper preventative maintenance can significantly help to prevent unplanned downtime and in real terms reduce the total cost of ownership. Valmet recommends inspecting the valves at least every five (5) years.

The inspection and maintenance interval depends on the actual application and process condition.

The inspection and maintenance intervals can be specified together with your local Valmet experts. During this periodic inspection the parts detailed in the Spare Part Set should be replaced.

Time in storage should be included in the inspection interval.

Maintenance can be performed as presented below. For maintenance assistance, please contact your local Valmet office. The part numbers in the text refer to the exploded view and to the parts list in Section 10, unless otherwise stated.

NOTE:

When sending goods to the manufacturer for repair, do not disassemble them. Clean the valve carefully and flush the valve internals. For safety reasons, inform the manufacturer of the type of medium used in the valve (include material safety datasheets (MSDS)).

NOTE:

In order to ensure safe and effective operation, always use original spare parts to make sure that the valve functions as intended.

NOTE:

For safety reasons, replace pressure retaining bolting if the threads are damaged, have been heated, stretched or corroded.

5.2 Replacing the gland packing

CAUTION:

Do not dismantle the valve or remove it from the pipeline while the valve is pressurized!

RA series

In gland packing, V-ring set (20), tightness is ensured by pressure caused by the wave spring (32). See Fig. 17.

The gland packing must be replaced when leakage occurs through the gland (9).

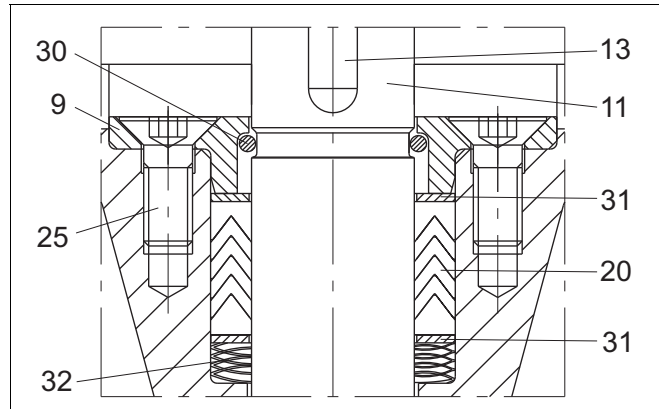


Fig. 17 Gland packing

- Make sure the valve is not pressurized.
- Remove the actuator from the valve shaft acc. to the instructions given in the actuator's manual.
- Remove the key (13) from the drive shaft (11). Unfasten the screws (25) and the gland (9).
- Remove the retainer (30) from the drive shaft. Avoid to damage the shaft's surface.
- Remove the upper sheet ring (31).
- Remove the old packing rings (20) using a pointed pin. Avoid to damage the sealing surfaces.
- Remove the lower sheet ring (31) and the wave spring (32).
- Clean the packing ring counterbore.
- Mount the spring (32) and the lower sheet ring (31) into the counterbore.
- Mount the new packing rings (20) one by one on the shaft (11) using the gland (9) as a tool. The keyway and shoulder must not damage the packing rings.
- Mount the upper sheet ring (31).
- Mount the retainer (30) into the groove of the shaft. Avoid to damage the surface of the shaft.
- Fasten the gland (9) with the screws (25) and tighten them according to the Table 1.
- Mount the key (13) on the shaft (11).

Table 1 Torques for gland screws

Thread	Torque, Nm	Width across flats
M6	8	4 mm
M8	18	5 mm
UNC 1/4	8	5/32"
UNC 5/16	18	3/16"

RE / RE1 series

In gland packings, tightness is ensured by the contact between the gland follower and the packing rings. See Fig. 18.

The gland packing (20) must be replaced if leakage occurs even after the hexagon nuts (25) have been tightened.

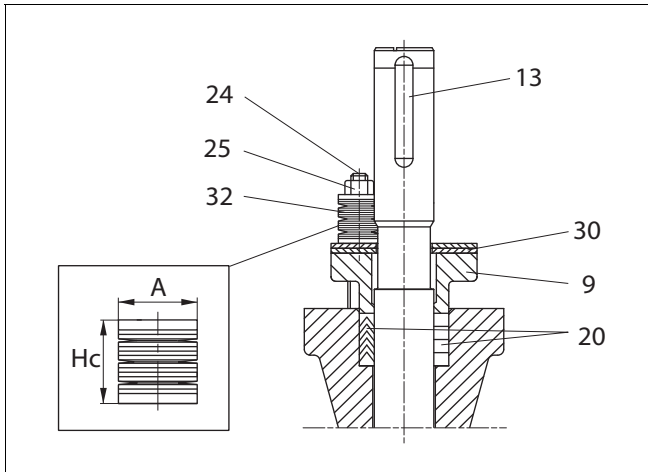


Fig. 18 Gland packing, RE/RE1

- Make sure that the valve is not pressurized.
- Detach the actuator and bracket according to the instructions in Section 4.3.
- Remove the key (13).
- Remove the hexagon nuts (25), disc spring sets (32), one stud (24), retaining plates (30) and gland follower (9).
- Remove the packing rings (20) from around the shaft using a knife or some other pointed instrument without scratching the surfaces.
- Clean the packing ring counterbore.
- Place the new packing rings (20) over the shaft (11). The gland follower may be used for pushing the rings into the counterbore. Do not damage packing rings in the shaft keyway. See Fig. 18.
- Screw down the removed stud.
- Deform the packing rings first by tightening the gland nuts (25) without disc springs to the torque T_t , see the value from Table 2.
- Remove the gland nuts and one stud. Mount the retaining plates (30) with the text UPSIDE on top and the removed stud and place the disc spring sets (32) on the gland studs. Tighten the nuts (25) so that the disc springs are compressed to the height H_c , see Table 2. Lock the nuts with locking compound e.g. Loctite 221. See Fig. 18.
- Check leakage when the valve is pressurized.

CAUTION:

For safety reasons the retainer plates MUST always be installed according to the above instructions.

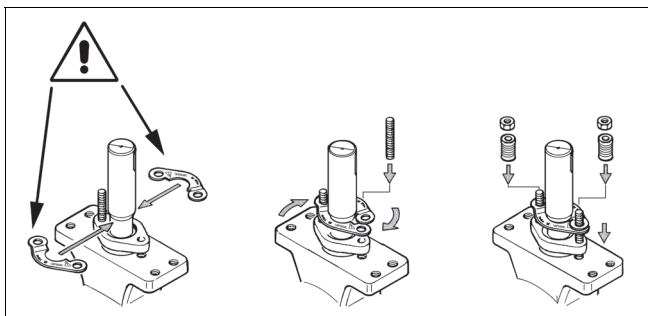


Fig. 19 Installing the retainer plates

Table 2 Tightening of the gland packing

Valve size	A (mm)	Hc (mm)	Tt (Nm)
DN 25 / 01	20	20.5	5
DN 40 / 1H	20	20.5	5
DN 50 / 02	20	20.5	5
DN 65 / 2H	20	20.5	5
DN 80 / 03	20	20.0	7
DN 100 / 04	20	20.0	7
DN 150 / 06	25	29.0	12
DN 200 / 08	25	29.0	14
DN 250 / 10	25	28.0	16
DN 300 / 12	25	28.0	18
DN 350 / 14	35.5	38.0	38
DN 400 / 16	35.5	37.0	45
DN 500 / 20	40	42.0	70
DN 600 / 24	40	41.5	90
DN 700 / 28	40	41.5	90

5.3 Detaching the actuator

CAUTION:

When handling the valve or the valve package, take its weight into account!

CAUTION:

Make sure the actuator is not pressurized when removing it.

CAUTION:

Make sure the valve is not pressurized when removing actuator.

NOTE:

Before dismantling, carefully observe the position of the valve in relation to the actuator and positioner/limit switch so as to make sure that the package can be properly re-assembled.

It is generally most convenient to detach the actuator and its auxiliary devices before removing the valve from the pipeline. If the valve package is small or if it is difficult to access, it may be more practical to remove the entire package at the same time.

See Section 6 for details of detaching actuators.

5.4 Removing the valve from the pipeline

CAUTION:

Do not dismantle the valve or remove it from the pipeline while the valve is pressurized!

- Make sure that the pipeline is not pressurized and that it is empty. Also make sure that no medium is led into the pipeline while the valve is being removed or after it has been removed.
- Place the hoisting ropes carefully, unscrew the pipe flange bolts and lift the valve from the pipeline using the ropes. Note the correct lifting method. See also Fig. 13.

5.5 Replacing the seat

S- or U-seat (not DN25-50) can be changed as described in 5.5.1 & 5.5.2. For DN25-50 and other seats, the valve needs to be dismantled as described in 5.6.

Detaching the S- or U-seat

- The valve must be removed from the pipeline.
- Turn the segment (3) so that it does not touch the seat, Fig. 20.

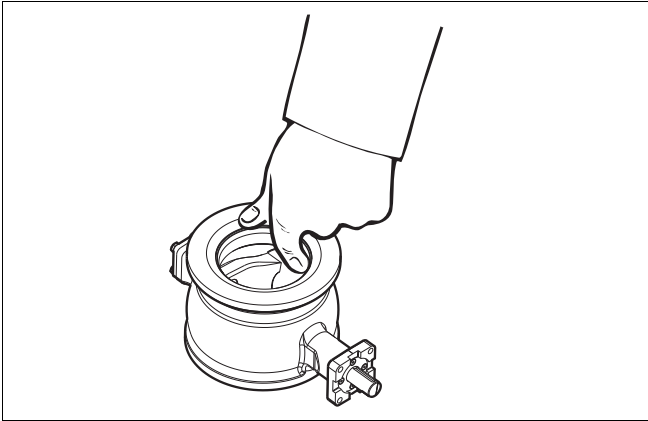


Fig. 20 Turning the ball segment

- In DN 65-100 valves (excluding the low-Cv versions), unfasten the blind flange (10) and push the segment into the back position, Fig. 21.

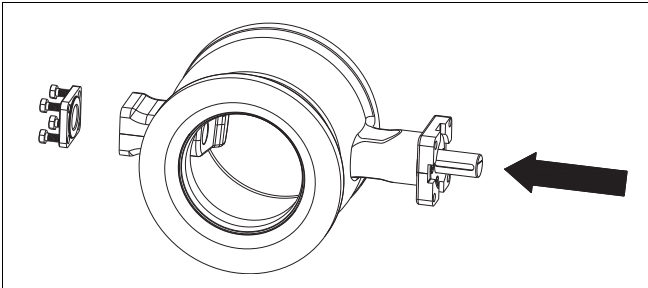


Fig. 21 Removing the blind flange

- DN 65-100 valves can be dismantled, as described in 5.6, to make the replacement of the seat easier.
- Tap the seat (4) with a soft spindle all around the circumference from the upstream side to make it fall into the body, Fig. 22.

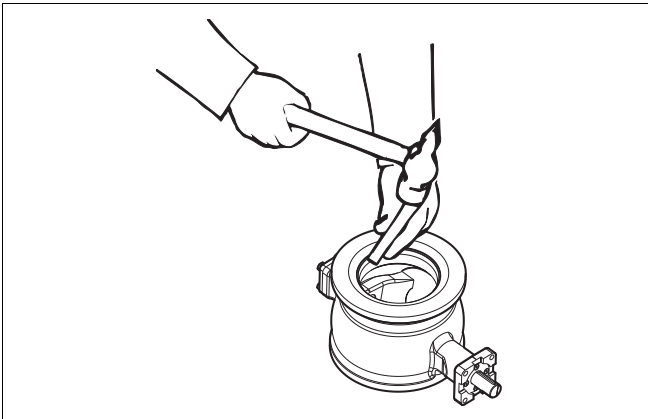


Fig. 22 Knocking off the seat

- Turn the valve and lift the seat from the body through the downstream flow port, Fig. 23.

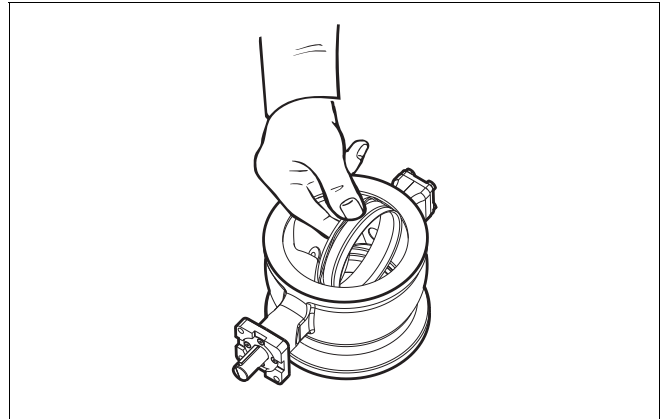


Fig. 23 Lifting the seat

Installing the seat

The back seal (6) of the segment seat (4) is normally a lip seal. The seat is easier to install if the back seal is precompressed. An O-ring seal does not need precompression.

- Clean the flow port that houses the seat. Remove any burrs. Round off the edges using a fine abrasive paper and clean the flow port carefully, see Fig. 24. Place the back seal (6) onto the seat (4).
- Lubricate the flow port, seat (4) and back seal (6) and the lock spring (5) with a volatile lubricant, e.g. Hyprez. Make sure that the lubricants are compatible with the medium.
- **Only for a lip seal:** Push the seal carefully into the flow port for about 15 minutes, Fig. 25. The following work phases must be completed before the precompression is lost.

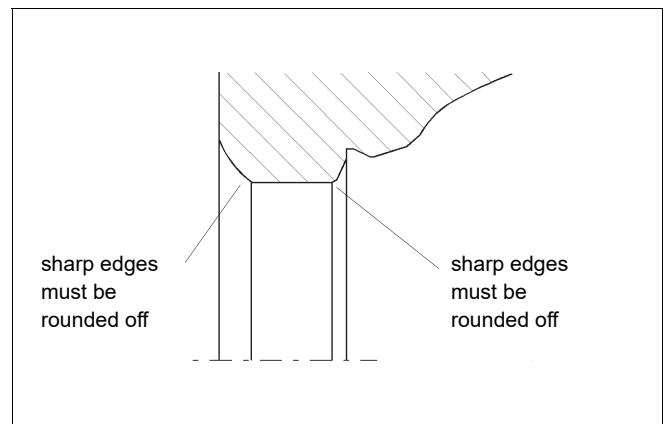


Fig. 24 Rounding the sharp edges

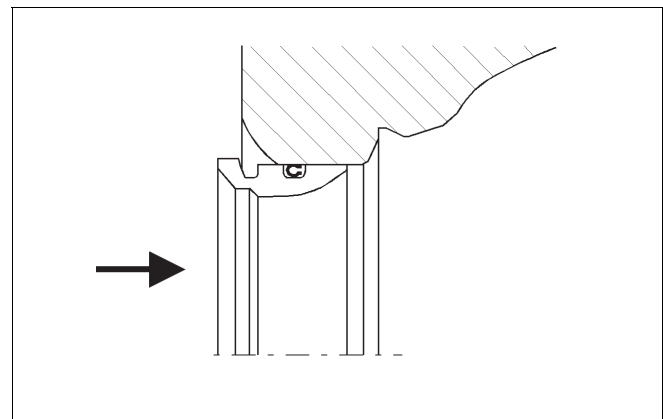


Fig. 25 Precompression of the lip seal

- Place the lock spring (5) on the seat.
- When the valve is opened, the ends of the spring must be by the V-shaped opening, see Fig. 26.

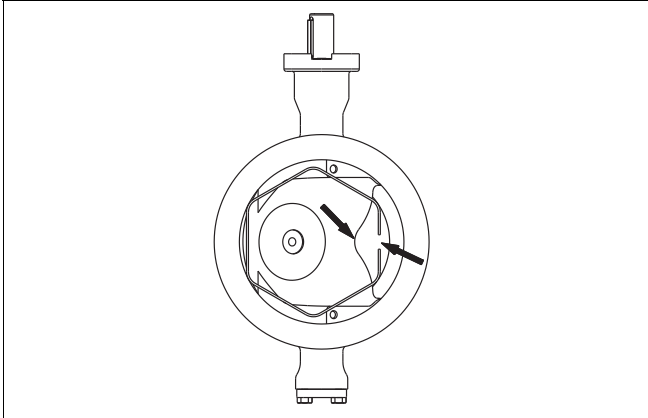


Fig. 26 Mounting the seat

- Place the seat package into the body as shown in Figs. 27 and 28.

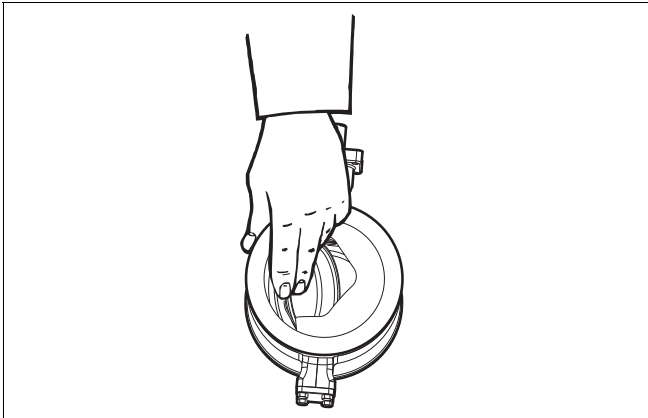


Fig. 27 Slipping the seat into the body

- Check that the spring angles extend to the control face.

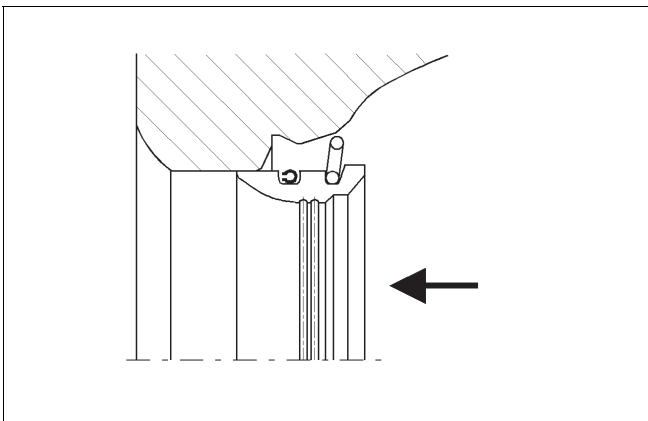


Fig. 28 Pushing the the spring angles against the control face

- Place a screwdriver on each visible spring angle one after the other and knock the spring into the groove, see Fig. 29.
- Turn the segment 180° clockwise and knock the rest of the spring angles into the groove, Fig. 30. A special tool available from the manufacturer may also be used for the work phases in Figs. 29 and 30.

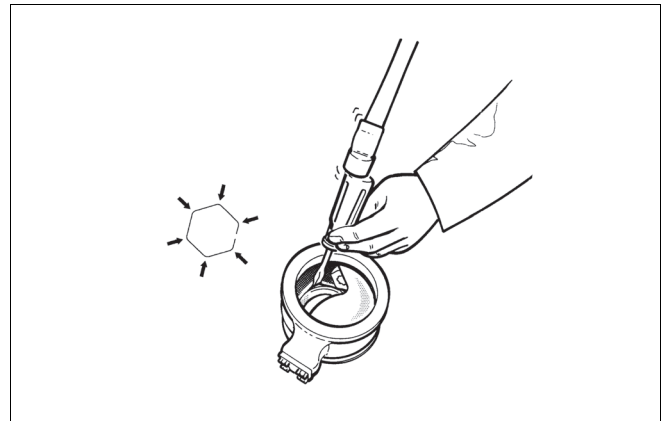


Fig. 29 Knocking the spring into the groove

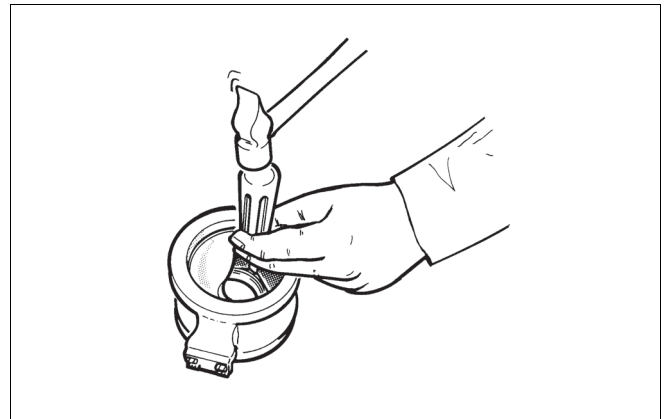


Fig. 30 Knocking the spring after turning the seat around

- Use a plastic spindle to ensure that the seat is correctly placed and can move freely, Fig. 31.

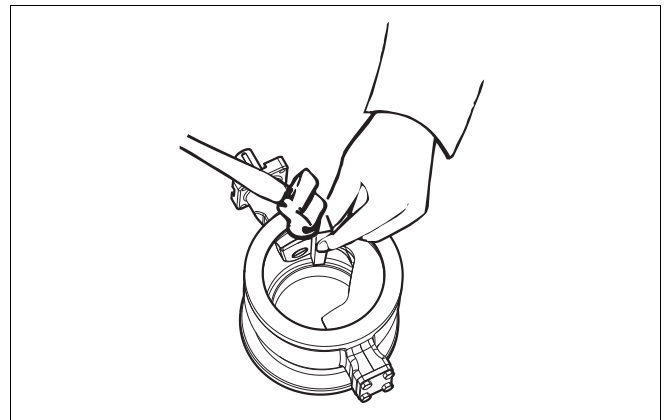


Fig. 31 Securing with a plastic spindle

5.6 Dismantling the valve

- Turn the valve into the closed position.
- Remove the pin lockings either by grinding or using a spindle. Detach the pins (14 and 15) by drilling, Fig. 32. Be careful not to damage the original bores. Note! The pins and the drive shaft have been secured by welding in the titanium version and in the acid-resistant high-consistency version S.
- Detach the retainer plates (30).
- Detach the gland packings (20).
- Remove the shafts (11 and 12), Fig. 33.

- Lift the segment from the body.
- Remove the bearings (16 and 17) and clean the bearing spaces.
- Remove the seat by pushing it evenly inside the body.

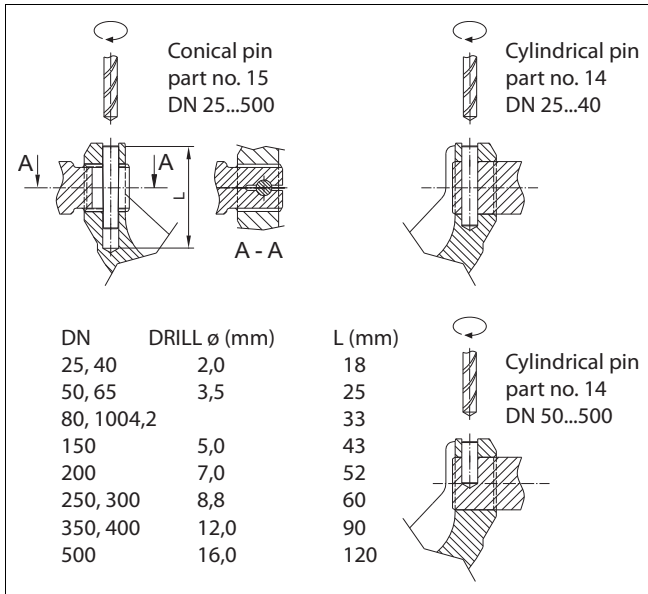


Fig. 32 Drilling the pin

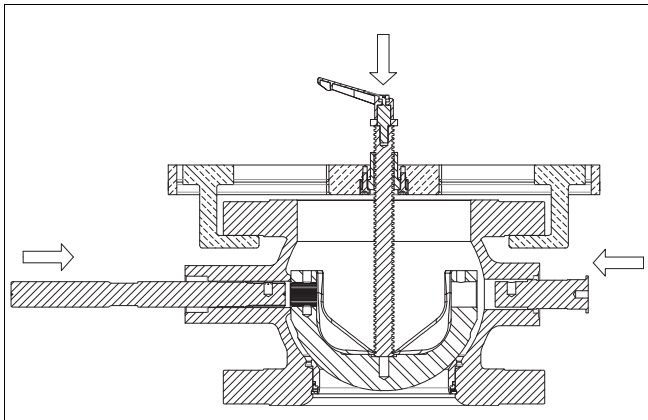


Fig. 33 Installing the shafts

5.7 Inspection of removed parts

- Clean the removed parts.
- See if the shafts (11, 12) and bearings (16, 17) are damaged.
- Check if the sealing surfaces of the segment and the seat (4) are damaged.
- If necessary, replace the parts with new.

5.8 Assembly

- The bearing material of the standard construction valves is PTFE-impregnated stainless steel net. The bearings for the high temperature valves are cobalt alloy bushings which are mounted into the body together with the shafts. High temperature is over +260 °C.
- Put the bearings (16, 17) in their places.
- Mount the S, U or T-seat as explained in 4.5.2.
- For A-seat (Fig. 34), mount the retaining ring (7) to the groove in Body (1). Install back seal (6), support ring (8) and spring (5) to the seat (7). Mount the assembled seat package to the body. Use a plastic spindle to ensure that the seat is correctly placed.
- Mount the segment in the body in the closed position. In the low Cv version, insert the filling ring (22) between the drive shaft (11) and segment (3). Press the segment to fit the shaft (12).
- For A-seat special compression tool is needed for compress the spring to mount the shaft and drive shaft. See Fig. 33.

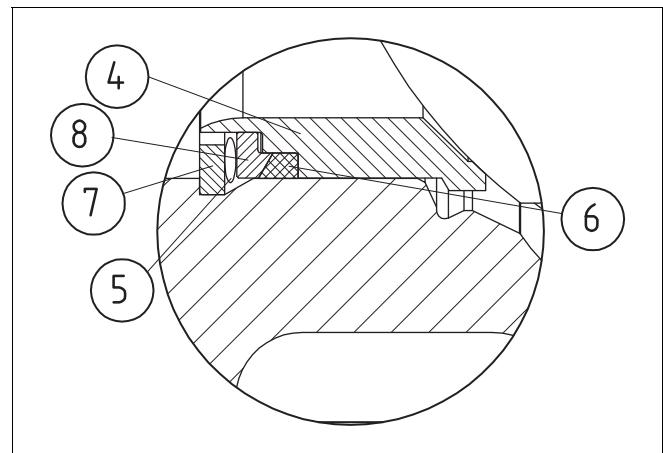


Fig. 34 A-seat

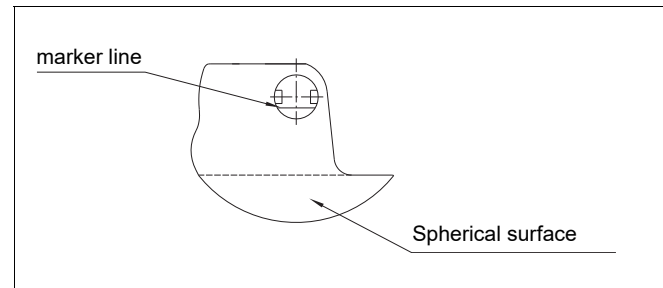


Fig. 35 Segment and shaft positions

- Install the drive shaft (11). Note the location of the pin hole and the keyway. See Figs. 36 and 37.
- High temperature-construction: Mount the bearings (16, 17 and 18) into the shafts. Spray a thin layer of dry lubricating fluid, e.g. Molykote 321R or equivalent, into the inside surface of the bushing and the shaft bearing groove. Press the bushing with a tightening ring into the shaft bearing groove and fit the shaft with the bearings carefully into the body through the tightening ring.
- Please note the depth of the hole (L) for the conical pin, Fig. 32. Use a former to check the proper shaft position of low Cv valves, see Fig. 36. Put the pins (14, 15) in their places and lock them, Fig. 37. Both pins are locked with TIG welding in the high-consistency acid-resistant version and in the standard and high-consistency titanium versions. Moreover, the drive shaft is welded to the segment in the high-consistency versions. Contact the manufacturer for more information.

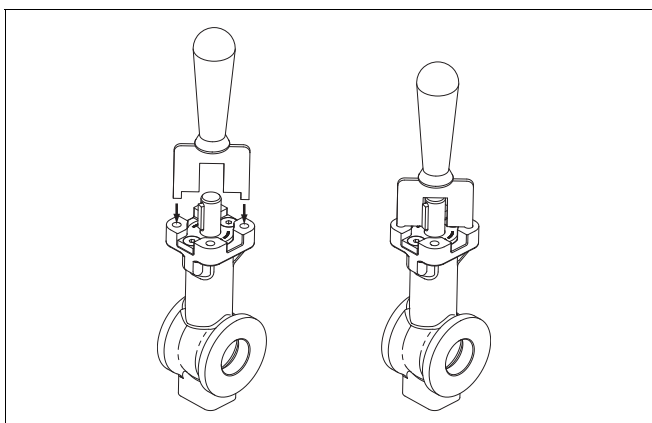


Fig. 36 Using a former to check shaft position

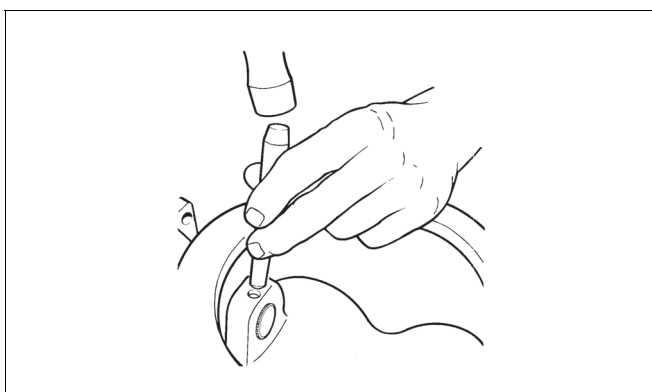


Fig. 37 Locking a pin

- Install the blind flange (10) with gaskets (19), tighten the bolts (26), see Table 3.
- Install the gland packing according to Section 5.2.

Table 3 Screw torques (for lubricated screws)

Screw	M6 UNC 1/4	M8 UNC 5/16	M10 UNC 3/8	M12 UNC 1/2	M16	M29
Torque, Nm	8	18	35	65	170	330

6 TESTING THE VALVE

CAUTION:

Pressure testing should be carried out using equipment conforming to the correct pressure class!

We recommend that the valve body be pressure tested after the valve has been assembled.

The pressure test should be carried out in accordance with an applicable standard using the pressure rating required by the pressure class or flange bore of the valve. The valve must be in the open position during the test.

If you also want to test the tightness of the closure member, contact the manufacturer.

7 INSTALLING AND DETACHING THE ACTUATORS

7.1 General

Different Neles actuators can be mounted using suitable brackets and couplings. The valve can be operated, for example, by actuators of the E, B1 or Quadra-Powr series.

7.2 Installing B1C actuators

CAUTION:

Beware of the segment movement!

- Drive the actuator piston to the extreme outward position and turn the valve into the closed position, see Fig. 38.
- Clean the shaft bore and file off any burrs. Lubricate the shaft bore.
- If a coupling is needed between the actuator shaft bore and the valve shaft, lubricate the coupling and install it in the actuator.
- Fasten the bracket loosely to the valve using lubricated screws.
- Push the actuator carefully onto the valve shaft. Avoid forcing it, since this may damage the segment and seat. We recommend mounting the actuator so that the cylinder is pointing upwards.
- Align the actuator as accurately as possible using the valve as a guide. Lubricate the mounting screws. Install the washers and tighten all screws, see Table 3.
- Adjust the segment open and closed positions (limits to piston movement) by means of the actuator stop screws, see Fig. 38. The correct opening angle is 90°, for the R2_S valve 70°. The accurate position can be seen in the flow port. Check that the yellow arrow indicates the position of the segment.
Keep your fingers out of the flow port!

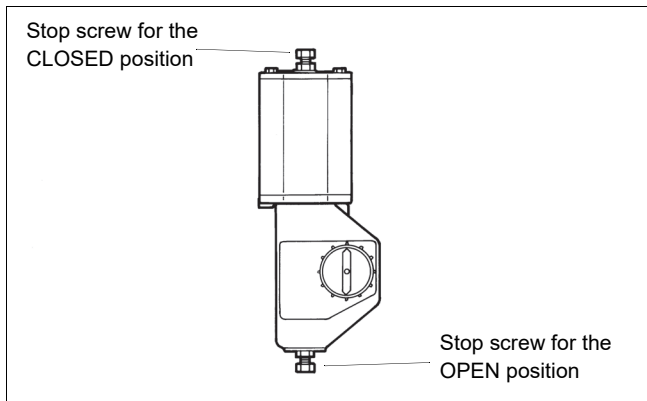


Fig. 38 Open and closed positions of a B1 actuator

There is no need to adjust the stop screw if the actuator is re-installed in the same valve. Drive the actuator piston to the housing end (open position). Turn the actuator by hand until the valve is in the open position (unless it is already open). Fasten the actuator in this position. The actuator may be installed in another position with respect to the valve by selecting another keyway in the actuator, see Fig. 39.

- Check the tightness of the stop screw at the end of the cylinder during cylinder operation. The threads must be sealed using an appropriate non-hardening sealant, e.g. Loctite 225.
- Check that the actuator is functioning correctly. Check the seg-

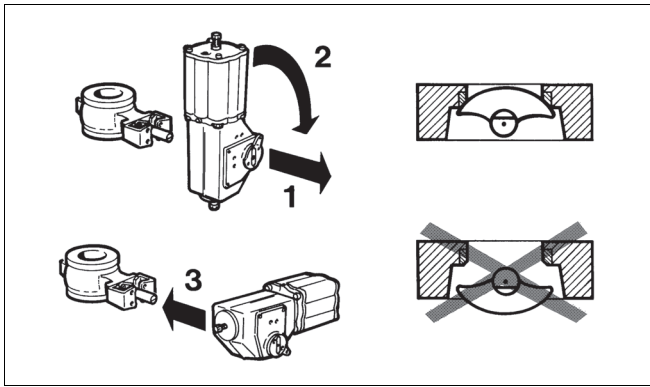


Fig. 39 Changing the actuator position

ment flow bore position and the actuator movement relative to the valve (clockwise: close, counterclockwise: open) after installing the actuator. The valve should be closed when the piston is in the extreme outward position.

- Check that the yellow arrow indicates the position of the segment. If necessary, change the position of the arrow.

7.3 Installing B1J actuators

Spring-return actuators are used in applications where valve opening or closing movement is needed in case the air supply is interrupted. The B1J type is used for spring-to-close operation; the spring pushes the piston towards the cylinder end, the extreme outward position. In turn, the B1JA type is used for spring-to-open operation; the spring is between the piston and the cylinder end and pushes the piston towards the housing.

Spring-return actuators are installed in a manner similar to B1C series actuators, taking into account the following.

Type B1J

Install the actuator so that the piston is in the extreme outward position. The cylinder must not be pressurized and air supply connections must be open. The valve must be in the closed position, see Fig. 16.

Type B1JA

Install the actuator so that the piston is in the cylinder-end position at housing side. The cylinder must not be pressurized and the air supply connection must be open. The valve must be in the open position, see Fig. 16.

The rest of the installation procedure is the same as for B1C actuators.

7.4 Detaching B series actuators

CAUTION:

Make sure the valve is not pressurized when removing the actuator.

- Disconnect the actuator from its power source; detach the air supply pipe and control signal cables or pipes from their connectors.
- Unscrew the bracket screws.
- Detach the actuator using a suitable extractor, see Fig. 40. The tool can be ordered from the manufacturer.
- Remove the bracket and coupling, if any.

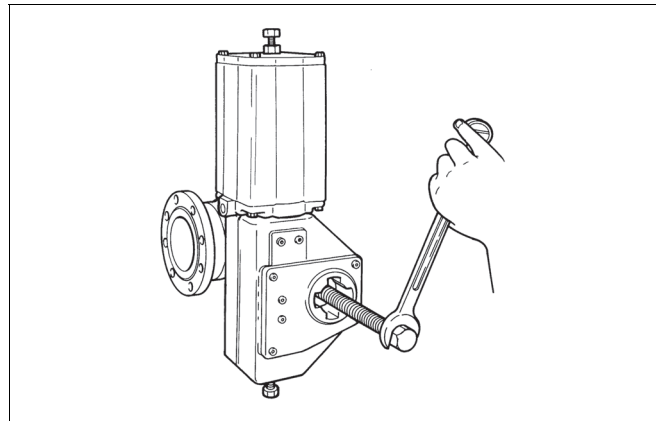


Fig. 40 Detaching an B series actuator

7.5 Installing a Quadra-Powr™ actuator

CAUTION:

Beware of the segment movement!

Quadra-Powr actuators may be used for spring-to-close and spring-to-open operations depending on the installation position. After selecting the desired operation, see Fig. 41 for the correct installation position.

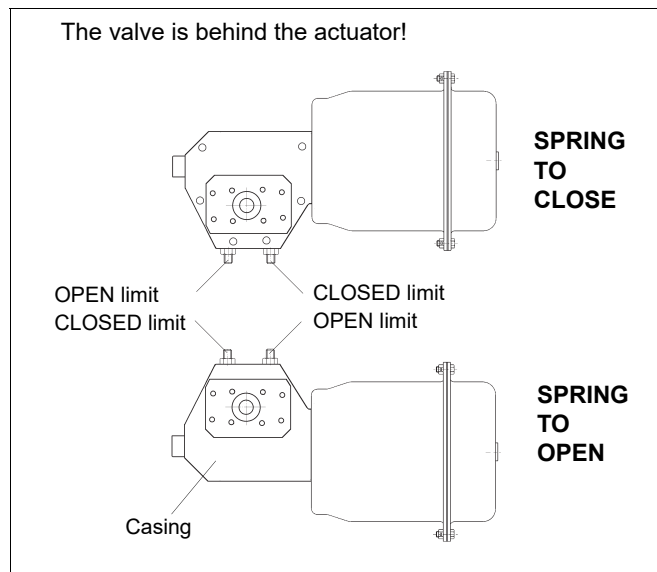


Fig. 41 Installation of a Quadra-Powr actuator and adjustment of the open and closed limits

- The actuator must not be pressurized and the air supply connection must be open.
- Turn the valve segment to correspond to the spring operation: clockwise close, counterclockwise open. The marker line at the end of the shaft shows the position, see Fig. 16.
- Clean the actuator shaft bore and lubricate it.
- Push the actuator carefully onto the valve shaft. Avoid forcing it, since this may damage the segment and seat.
- Lubricate the actuator mounting screws and screw them in. Tighten all screws, see Table 3.

Adjust the valve open and closed positions by means of the screws at the side of the actuator; remember to tighten the locking nuts. See Fig. 41.

Keep your fingers out of the flow port!

8 TROUBLE SHOOTING TABLE

Table 4 lists malfunctions that might occur after prolonged use.

Table 4 Trouble shooting

Symptom	Possible fault	Recommended action
Leakage through a closed valve	Wrong stop screw adjustment of the actuator	Adjust the stop screw for closed position
	Faulty zero setting of the positioner	Adjust the positioner
	Damaged seat	Replace seat
	Damaged closing member	Replace the closing member
	Closing member in a wrong position relative to the actuator	Select the correct keyway in the actuator
Leakage through body joint	Damaged gasket	Replace the gasket
	Loose body joint	Tighten the nuts or screws
Irregular valve movements	Actuator or positioner malfunction	Check the operation of the actuator and positioner
	Process medium accumulated on the sealing surface	Clean the sealing surfaces
	Closing member or seat damaged	Replace the closing member or seat
	Crystallizing medium has entered the bearing spaces	Flush the bearing spaces
Gland packing leaking	Gland packing worn or damaged	Replace the gland packing
	Loose packing	Tighten the packing nuts

9 TOOLS

In addition to standard tools the following special tools might be needed to facilitate working.

- For removal of the actuator

Product:	ID:
B1C/B1J 6	303821
B1C 8-11 / B1J 8-10	8546-1
B1C 12-17 / B1J 12-16	8546-2
B1C/B1J 20	8546-3
B1C/B1J 25	8546-4
B1C/B1J 32	8546-5
B1C 40 / B1J 322	8546-6
B1C 50	8546-7
B1C 502	8546-8

- For mounting and removal of the seat.

Product:	ID:
DN 01	273336
DN 015	273337
DN 02	273338
DN 03	273339
DN 04	273340
DN 06	273341
DN 08	273342
DN 10	273343
DN 12	273344

- Shaft position checking (low Cv valves)
 - former H069563 (Series RA)
 - former H069564 (Series RE, RE1)

These are available from the manufacturer.

10 ORDERING SPARE PARTS

NOTE:

Always use original spare parts to make sure that the valve functions as intended.


When ordering spare parts, always include the following information:

- type code, sales order number, serial number (stamped on a valve body)
- number of the parts list, part number, name of the part and quantity required

This information can be found from the identification plate or documents.

11 EXPLODED VIEWS AND PARTS LISTS

11.1 Series RA

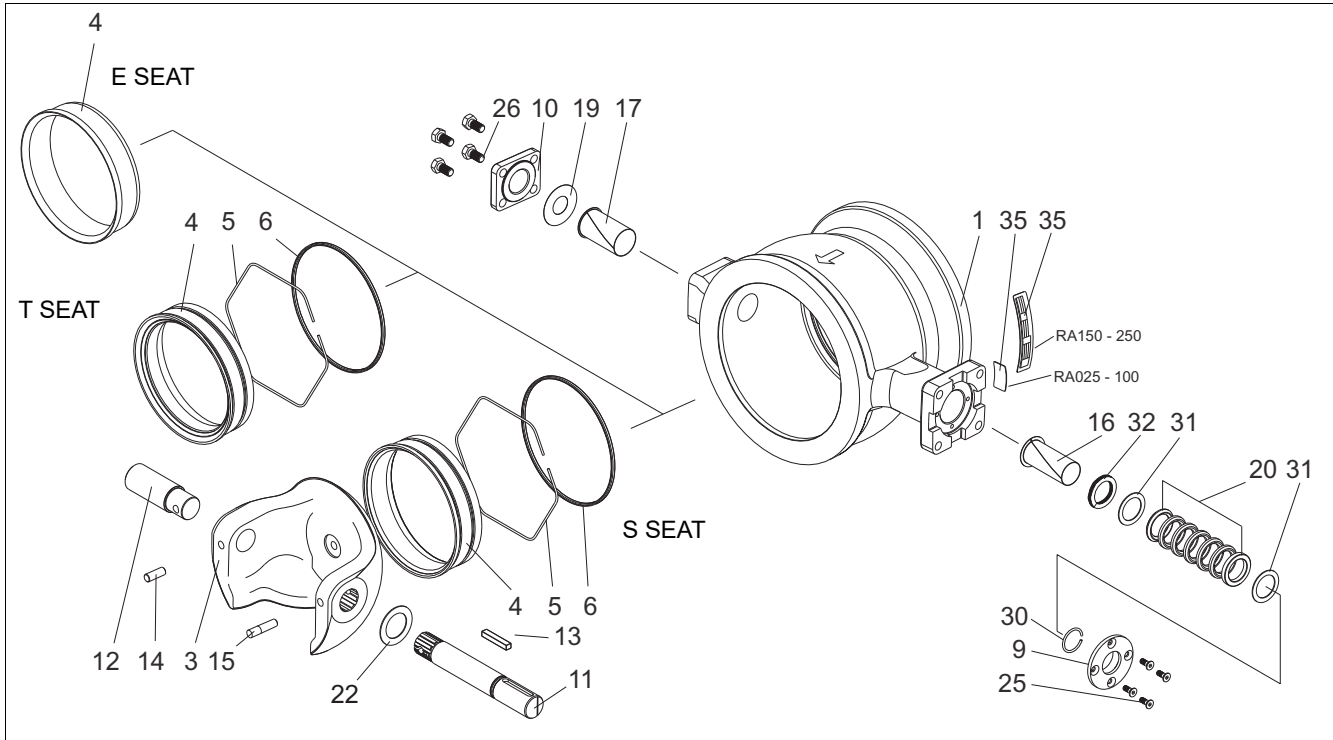

Item	Qty.	Description	Spare part category
1	1	Body	
3	1	Segment	3
4	1	Seat	2
5	1	Lock spring	2
6	1	Back seal	2
9	1	Gland follower	
10	1	Blind flange	
11	1	Drive shaft	3
12	1	Shaft	3
13	1	Key	3
14	1	Cylindrical pin	3 (Cat. 2 for sizes 01"-02")
15	1	Cylindrical pin	3 (Cat. 2 for sizes 01"-02")
16	1	Bearing	3
17	1	Bearing	3
19	1-2	Sealing plate	1
20	1	Packing	1
22	1	Filling ring (only in new low Cv version)	
25	2-4	Countersunk screw	
26	4	Hexagon screw	
30	2	Retainer ring	
31	2	Sheet ring	
32	1	Wave spring	
35	1	Identification plate	


Spare part set category: Recommended soft parts, always needed for the repair. Delivered as a set.

Spare part category 2: Parts for replacing of the seat. Delivered as a set.

Spare part category 3: Parts for replacing of the closing element.

Spares for the full overhaul: All parts from the categories 1, 2 and 3.

11.2 Series RE

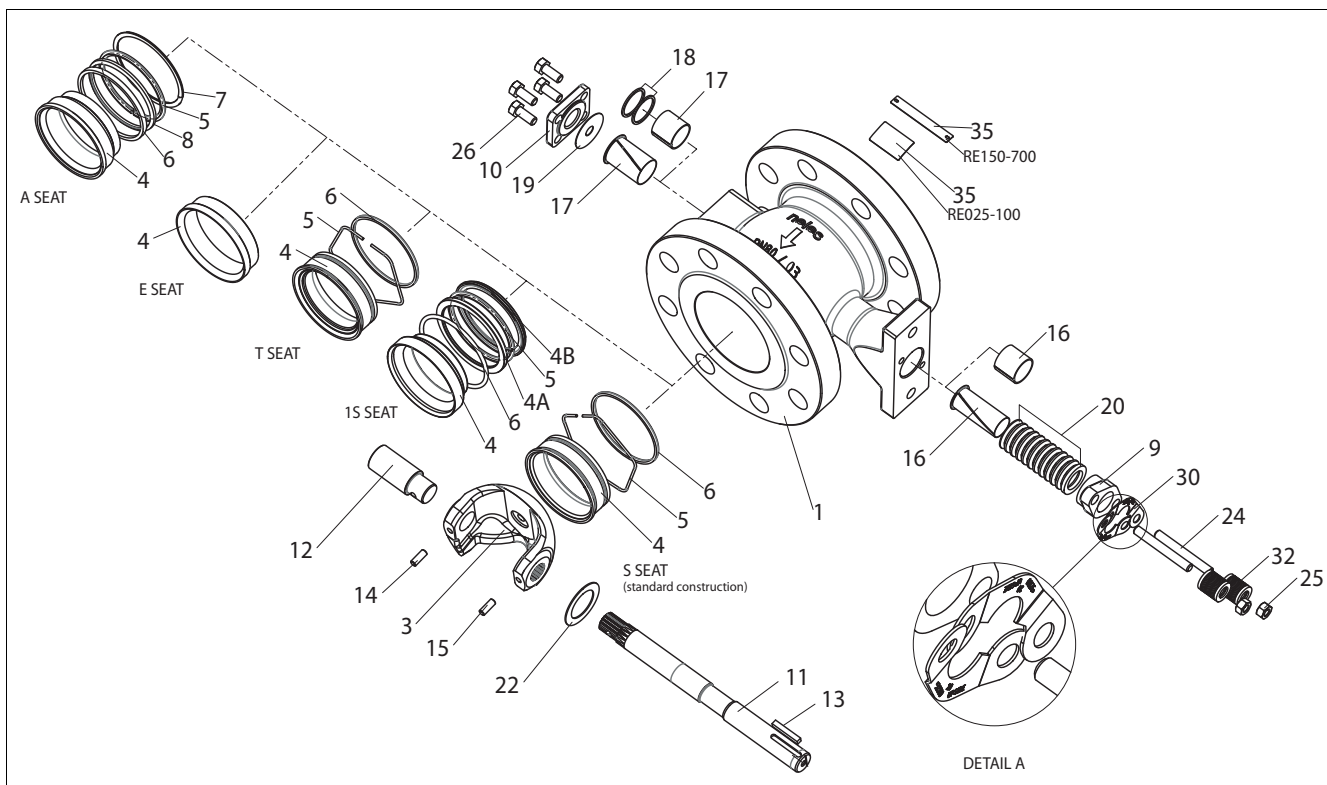

Part	Name	Stainless steel	Carbon steel	Spare part cat.
1	Body	ASTM A351 gr. CF8M	ASTM A216 gr. WCB	
3	V-port segment	AISI 329 + chromium / CG8M + chromium ¹⁾	AISI 329 + chromium / CG8M + chromium ¹⁾	3
4	Seat	AISI 316 + Cobalt based alloy / PTFE ¹⁾	AISI 316 + Cobalt based alloy / PTFE ¹⁾	2
4A	Back ring	AISI 316	AISI 316	1
4B	Support ring	AISI 316	AISI 316	1
5	Lock spring	INCONEL 625	INCONEL 625	
6	Back seal	Stainless steel + PTFE / Viton GF / Graphite	Stainless steel + PTFE / Viton GF / Graphite	
7	Retaining ring	EN 10028-1.4571	EN 10028-1.4571	1
8	Support ring	AISI 316	AISI 316	1
9	Gland follower	ASTM A351 gr. CF8M	ASTM A351 gr. CF8M	
10	Blind flange	ASTM A351 gr. CF8M	ASTM A351 gr. CF8M	3
11	Drive shaft	AISI 329 / 17-4PH ¹⁾	AISI 329 / 17-4PH ¹⁾	3
12	Shaft	AISI 329 / 17-4PH ¹⁾	AISI 329 / 17-4PH ¹⁾	3
13	Key	AISI 329	AISI 329	3
14	Cylindrical pin	AISI 329 / 17-4PH ¹⁾	AISI 329 / 17-4PH ¹⁾	3 (Cat. 2 for sizes 01"-02")
15	Cylindrical pin	AISI 329 / 17-4PH ¹⁾	AISI 329 / 17-4PH ¹⁾	3 (Cat. 2 for sizes 01"-02")
16	Bearing	PTFE + SS net / cobalt based alloy ¹⁾	PTFE + SS net / cobalt based alloy ¹⁾	3
17	Bearing	PTFE + SS net / cobalt based alloy ¹⁾	PTFE + SS net / cobalt based alloy ¹⁾	3
18	Thrust bearing	Cobalt based alloy ¹⁾	Cobalt based alloy ¹⁾	2
19	Sealing plate	Graphite / PTFE	Graphite / PTFE	1
20	Packing	PTFE/Graphite ¹⁾	PTFE/Graphite ¹⁾	1
22	Filling ring (only low Cv 1"/DN 25)	Stainless Steel AISI 316	Stainless Steel AISI 316	
24	Stud	ISO 3506 A4-80/B8M	ISO 3506 A4-80/B8M	
25	Hexagon nut	ISO 3506 A4-80/B8M	ISO 3506 A4-80/B8M	
26	Hexagon bolt	ISO 3506 A4-80/B8M	ISO 3506 A4-80/B8M	
30	Retainer Plate	AISI 316	AISI 316	
32	Spring stack	SIS 2324 & CrMo Steel + ENP	SIS 2324 & CrMo Steel + ENP	
35	Identification plate	AISI 316	AISI 316	

Spare part set category: Recommended soft parts, always needed for the repair. Delivered as a set.


Spare part category 2: Parts for replacing of the seat. Delivered as a set.

Spare part category 3: Parts for replacing of the closing element.

Spares for the full overhaul: All parts from the categories 1, 2 and 3.


12 DIMENSIONS AND WEIGHTS

12.1 Series RA

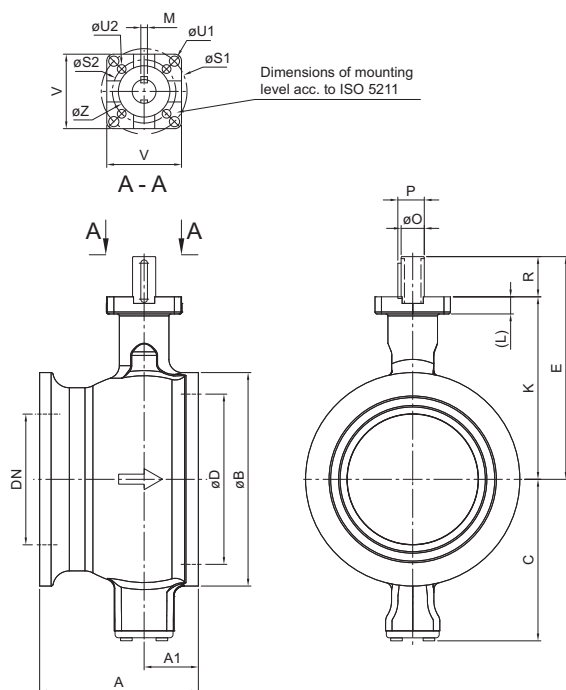

Type	DN	ISO 5211	Dimensions, mm																		kg
			A1	A	øB	C	øD	E	R	K	øO	M	P	øS1	øS2	øU1	øU2	øZ	L	V	
RA	25	F05	21	50	64	56	33	127	27	102	15	4.76	17	-	50	-	6.6	35	15.5	52	1.3
	40	F05	21	60	82	65	49	133.5	25	108.5	15	4.76	17	-	50	-	6.6	35	15.5	52	2.4
	50	F05, F07	27	75	100	91	60	144.5	25	119.5	15	4.76	17	70	50	9	6.6	55	15.5	67	3.7
	65	F05, F07	40	100	118	97	75	151	25	126	15	4.76	17	70	50	9	6.6	55	15.5	67	5.3
	80	F07, F10	38	100	130	108	89	177	35	142	20	4.76	22.2	102	70	11	9	70	16	94	6.2
	100	F07, F10	41	115	158	120	115	186	35	151	20	4.76	22.2	102	70	11	9	70	16	94	9.6
	150	F10, F12	55	160	216	174	164	244	44	200	25	6.35	27.8	125	102	14	11	85	22	114	24
	200	F10, F12	70	200	268	201	205	285	50	235	30	6.35	32.9	125	102	14	11	85	22	114	42
	250	F12, F14	82	240	324	251	259	338	61	277	35	9.53	39.1	140	125	18	14	100	26	136	68


12.2 RA-B1C

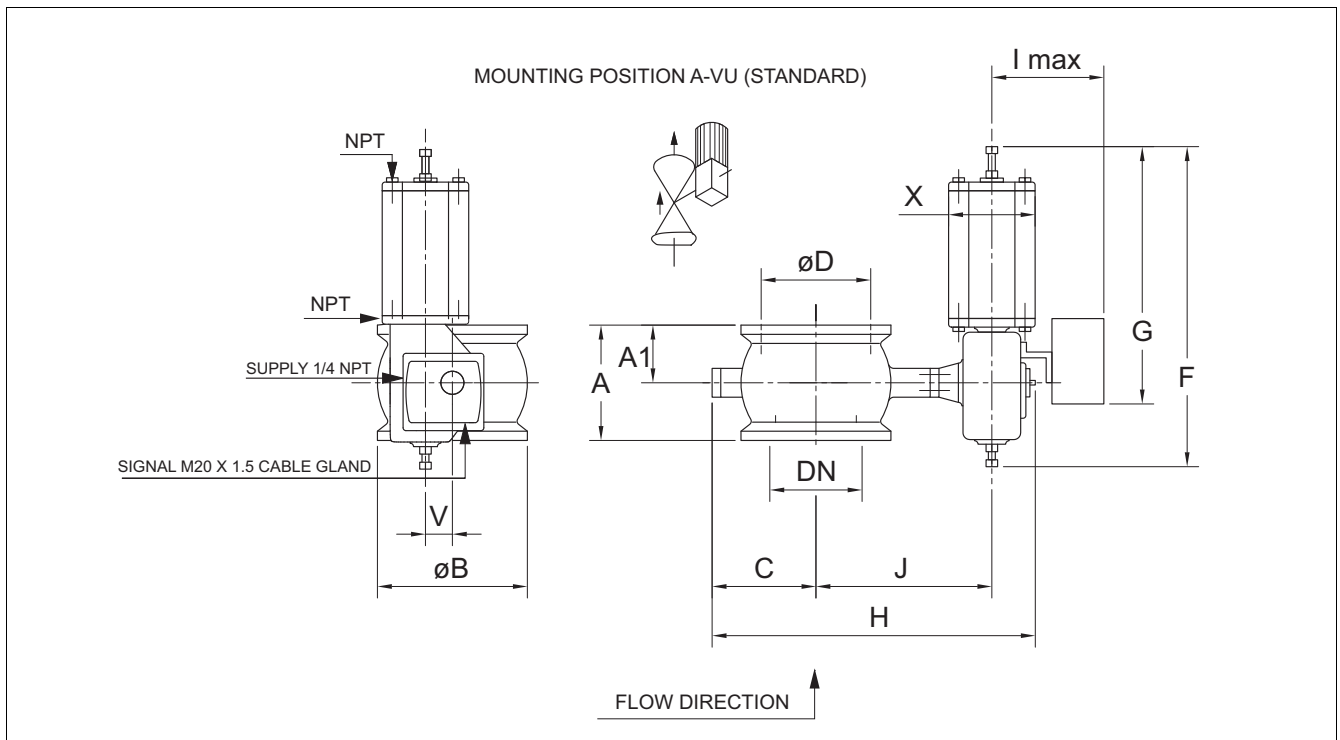

Type	Max Δp ¹⁾	Dimensions, mm													NPT	kg
		DN	A	A1	øB	C	øD	F	G	X	V	J	H	I _{max}		
RA_025-B1C6	50	25	50	21	64	56	33	400	260	90	36	168	305	310	1/4	5,5
RA_040-B1C6	50	40	60	21	82	65	49	400	260	90	36	175	320	310	1/4	6,6
RA_050-B1C6	50	50	75	27	100	91	60	400	260	90	36	185	355	310	1/4	8
RA_050-B1C9	50	50	75	27	100	91	60	455	315	110	43	185	365	305	1/4	13,5
RA_065-B1C6	50	65	100	40	118	97	75	400	260	90	36	192	367	310	1/4	9,5
RA_065-B1C9	50	65	100	40	118	97	75	455	315	110	43	192	380	305	1/4	15
RA_080-B1C6	50	80	100	38	130	108	89	400	260	90	36	200	390	310	1/4	11
RA_080-B1C9	50	80	100	38	130	108	89	455	315	110	43	200	400	305	1/4	16
RA_100-B1C6	40	100	115	41	158	120	115	400	260	90	36	210	410	310	1/4	15
RA_100-B1C9	40	100	115	41	158	120	115	455	315	110	43	210	420	305	1/4	19
RA_150-B1C9	25	150	160	55	216	174	164	455	315	110	43	260	515	305	1/4	34
RA_150-B1C11	40	150	160	55	216	174	164	540	375	135	51	265	530	310	3/8	40
RA_150-B1C13	40	150	160	55	216	174	164	635	445	175	65	280	550	325	3/8	55
RA_200-B1C9	15	200	200	70	268	201	205	455	315	110	43	294	575	305	1/4	52
RA_200-B1C11	32	200	200	70	268	201	205	540	375	135	51	310	590	310	3/8	59
RA_200-B1C13	35	200	200	70	268	201	205	635	445	175	65	325	610	325	3/8	73
RA_250-B1C13	30	250	240	82	324	251	259	635	445	175	65	366	730	325	3/8	100
RA_250-B1C17	35	250	240	82	324	251	259	770	545	215	78	373	750	340	3/8	125

1) Max Δp in on-off service with actuator load factor 0.6 and supply pressure 5 bar


12.3 RA - B1J, B1JA

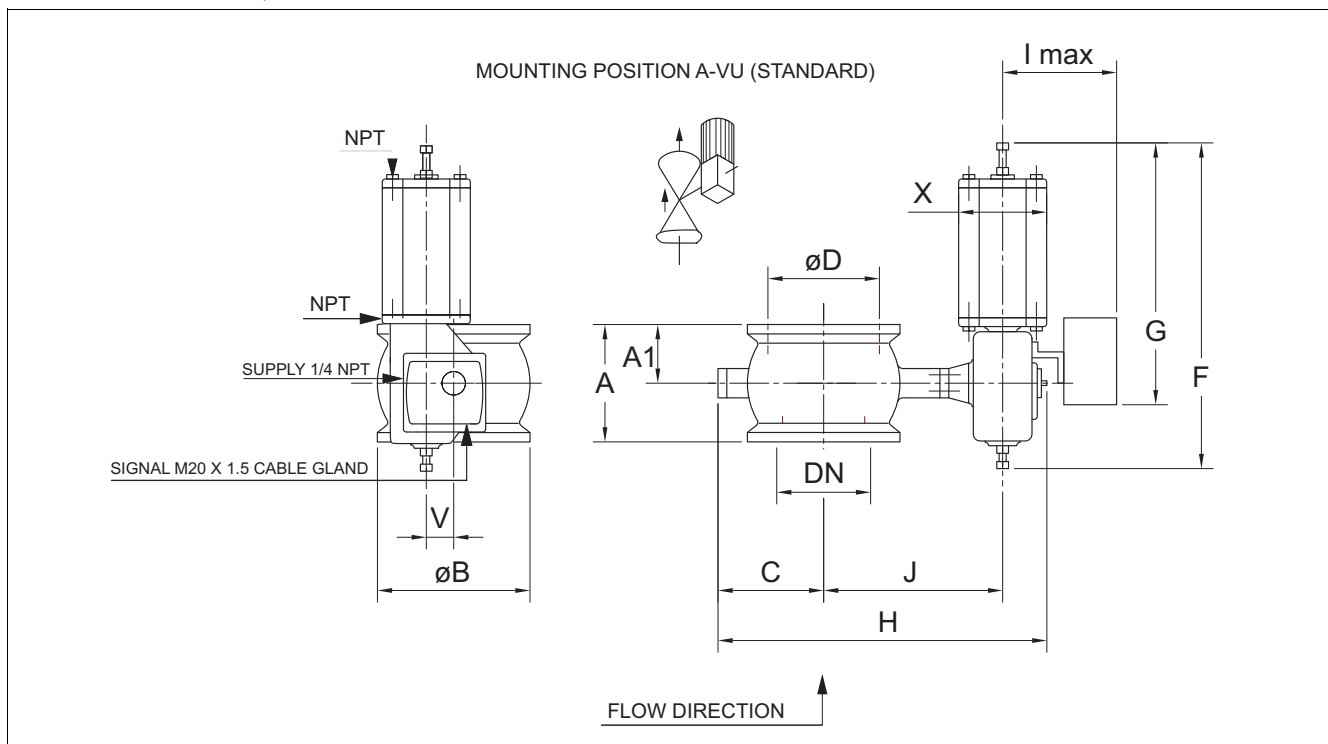

Type	Max Δp ¹⁾	Dimensions, mm													NPT	kg
		DN	A	A1	øB	C	øD	F	G	X	V	J	H	I _{max}		
RA_025-B1J6	50/50	25	50	21	64	56	33	485	368	110	36	166	291	280	3/8	14
RA_040B1J6	50/50	40	60	21	82	65	49	485	368	110	36	173	306	280	3/8	15
RA_050-B1J6	50/50	50	75	27	100	91	60	485	368	110	36	183	343	280	3/8	16
RA_065-B1J6	50/50	65	100	40	118	97	75	485	368	110	36	193	358	280	3/8	18
RA_080B1J6	50/50	80	100	38	130	108	89	485	368	110	36	198	374	280	3/8	19
RA_100-B1J6	50/50	100	115	41	158	120	113	485	368	110	36	208	398	280	3/8	22
RA_025-B1J8/B1JA8	50/50	25	50	21	64	56	33	555	420	135	43	168	293	305	3/8	19
RA_040-B1J8/B1JA8	50/50	40	60	21	82	65	49	555	420	135	43	175	308	305	3/8	20
RA_050-B1J8/B1JA8	50/50	50	75	27	100	91	60	555	420	135	43	185	345	305	3/8	21
RA_065-B1J8/B1JA8	50/50	65	100	40	118	97	75	555	420	135	43	195	360	305	3/8	23
RA_080-B1J8/B1JA8	50/50	80	100	38	130	108	89	555	420	135	43	200	376	305	3/8	24
RA_100-B1J8/B1JA8	50/50	100	115	41	158	120	113	555	420	135	43	210	400	305	3/8	27
RA_150-B1J8/B1JA8	10/25	150	160	55	216	174	164	555	420	135	43	258	500	305	3/8	41
RA_150-B1J10/B1JA10	40/40							650	490	175	51	275	530	225	3/8	55
RA_200-B1J10/B1JA10	15/25	200	200	70	268	201	205	650	490	175	51	310	590	310	3/8	75
RA_200-B1J12/B1JA12	32/35							800	620	215	65	324	635	235	1/2	100
RA_250-B1J16/B1JA16	35/35	250	240	85	324	251	259	990	760	265	78	373	760	340	1/2	170

1) Supply pressure BJ 4 bar / BJA 5 bar

12.4 RA - M

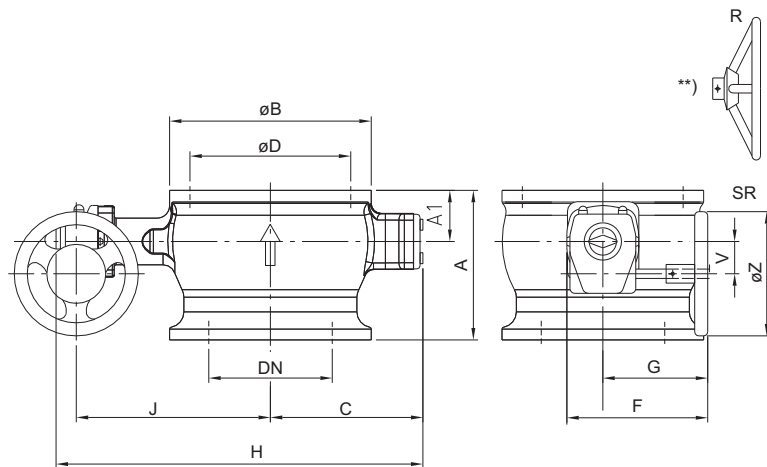


Type	Actuator/ mounting ISO 5211	DN	Dimensions, mm											kg
			ϕD	A	A1	ϕB	C	F	G	H	J	V	ϕZ	
RA	M07/15F05	25	33/38*	50	21	64	56	235	184	223	131	52	160	5.1
	M07/15F05	40	49	60	21	82	65	235	184	238	137	52	160	6.2
	M07/15F05	50	60	75	27	100	91	235	184	275	148	52	160	7.5
	M07/15F05	65	75	100	40	118	97	235	184	288	155	52	160	9.5
	M07/20F07	80	89	100	38	130	108	235	184	315	171	52	160	10
	M07/20F07	100	115	115	41	158	120	235	184	336	180	52	160	14
	M10/25F10	150	164	160	55	216	174	238	187	439	235	52	200	29
	M12/30F12	200	205	200	70	268	201	307	238	524	276	71	315	52
	M12/35F12	250	259	240	82	324	251	307	238	616	318	71	315	78
	M14/35F12	250	259	240	82	324	251	385	285	621	320	86	400	87

*) Actuators equipped with extended input shaft.

**) Actuators M07...M12 are equipped with handwheel type SR, actuators M14...M16 are equipped with handwheel type R.


12.5 Series RE

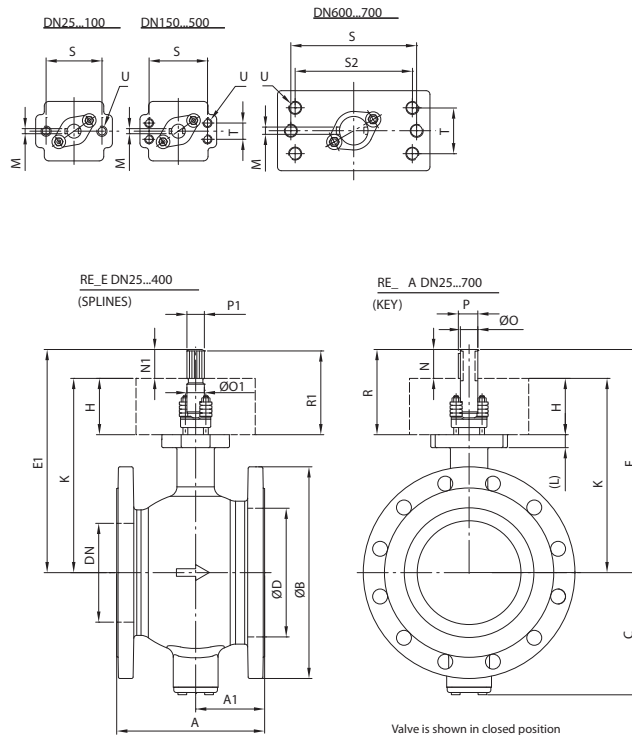

DN / inch	Dimensions, mm										Shaft dimensions, mm										
	A1	A	C	ØD	K	S/S2	T	U	L	H	RE_A (Key)						RE_E (Splines)				
											E	R	ØO	M	P	N	E1	R1	ØO1	P1/DIN5480	N1
25 / 1"	51	102	56	33	182	70	-	M10	15.5	80	207	105	15	4.76	17	25	203	101	15	W14x1x12	20
40 / 1 1/2"	57	114	65	49	188.5	70	-	M10	15.5	80	213.5	105	15	4.76	17	25	209.5	101	15	W14x1x12	20
50 / 2"	62	124	91	60	199.5	70	-	M10	15.5	80	224.5	105	15	4.76	17	25	219.5	100	15	W14x1x12	20
65 / 2 1/2"	72.5	145	97	75	206	70	-	M10	15.5	80	231	105	15	4.76	17	25	226	100	15	W14x1x12	20
80 / 3"	82.5	165	108	89	232	90	-	M12	16	90	267	125	20	4.76	22.2	35	253	111	20	W14x1x12	20
100 / 4"	97	194	120	113	241	90	-	M12	16	90	276	125	20	4.76	22.2	35	262	111	20	W18x1x16	20
150 / 6"	114.5	229	174	164	290	110	32	M12	22	90	335	135	25	6.35	27.8	46	315	115	25	W25x1x24	25
200 / 8"	111.5	243	201	205	345	130	32	M12	22	110	395	160	30	6.35	32.9	51	370	135	30	W25x1x24	25
250 / 10"	138.5	297	251	259	387	130	32	M12	26	110	445	168	35	9.53	39.1	58	422	145	35	W34x1x32	35
300 / 12"	154	338	269	300	417	160	40	M16	26	120	485	188	40	9.53	44.2	68	452	155	40	W34x1x32	35
350 / 14"	175	400	311	350	433	160	40	M16	29	120	513	200	45	12.70	50.4	80	468	155	45	W34x1x32	35
400 / 16"	160	400	353	400	494	160	55	M20	29	140	584	230	50	12.70	55.5	90	529	175	50	W34x1x32	35
500 / 20"	233	508	420	500	615	230	90	M27	40	180	727	292	70	19.05	78.2	119	-	-	-	-	-
600 / 24"	355	610	490	600	704	330/304.7	120	M30	40	220	838	354	75	19.05	81.9	134	-	-	-	-	-
700 / 28"	295	710	539	700	768	330/304.7	120	M30	55	220	914	366	85	22.225	95.3	146	-	-	-	-	-
800 / 32"	380	840	635	800	871.5	330/304.7	120	M30	55	220	1052	402	105	25.4	114.4	180	-	-	-	-	-

DN / inch	Flange dimensions, mm, and weights											
	REC ASME 150		RED ASME 300(600)		REJ PN10		REK PN16		REL PN25		REM PN40	
	B	kg	B	kg	B	kg	B	kg	B	kg	B	kg
25 / 1"	110	3.6	124	4.9(5.2)	115	4.6	115	4.6	115	4.6	115	4.6
40 / 1 1/2"	125	4.6	155	7.5(8.5)	150	6.2	150	6.2	150	6.2	150	6.2
50 / 2"	150	7.4	165	9.5(11.4)	165	8.8	165	8.8	165	8.8	165	8.8
65 / 2 1/2"	180	13	190(-)	13(-)	185	13	185	13	185	13	185	13
80 / 3"	190	14	210	19(22.6)	200	16	200	16	200	16	200	16
100 / 4"	230	21	254(275)	29(41.4)	220	18	220	18	235	21	235	21
150 / 6"	280	39	320	54	285	37	285	37	300	42	300	42
200 / 8"	345	62	380	83	340	56	340	60	360	64	375	71
250 / 10"	405	95	445	132	395	90	405	91	425	101	450	125
300 / 12"	485	143	520	203	445	124	460	130	485	166	515	189
350 / 14"	535	194	585	290	505	174	520	182	555	248	580	275
400 / 16"	595	249	650	364	565	223	580	235	620	314	660	361
500 / 20"	700	453	775	595	670	375	715	468	730	486	755	549
600 / 24"	815	853	915	1051	780	791	840	899	845	910	890	1007
700 / 28"	925	1260	1035	1535	895	1134	910	1146	960	1243	1145	1338
800 / 32"	1060	1850	1150	-	1102	1550	1025	1570	1085	1790	-	-

12.6 RE - B1C

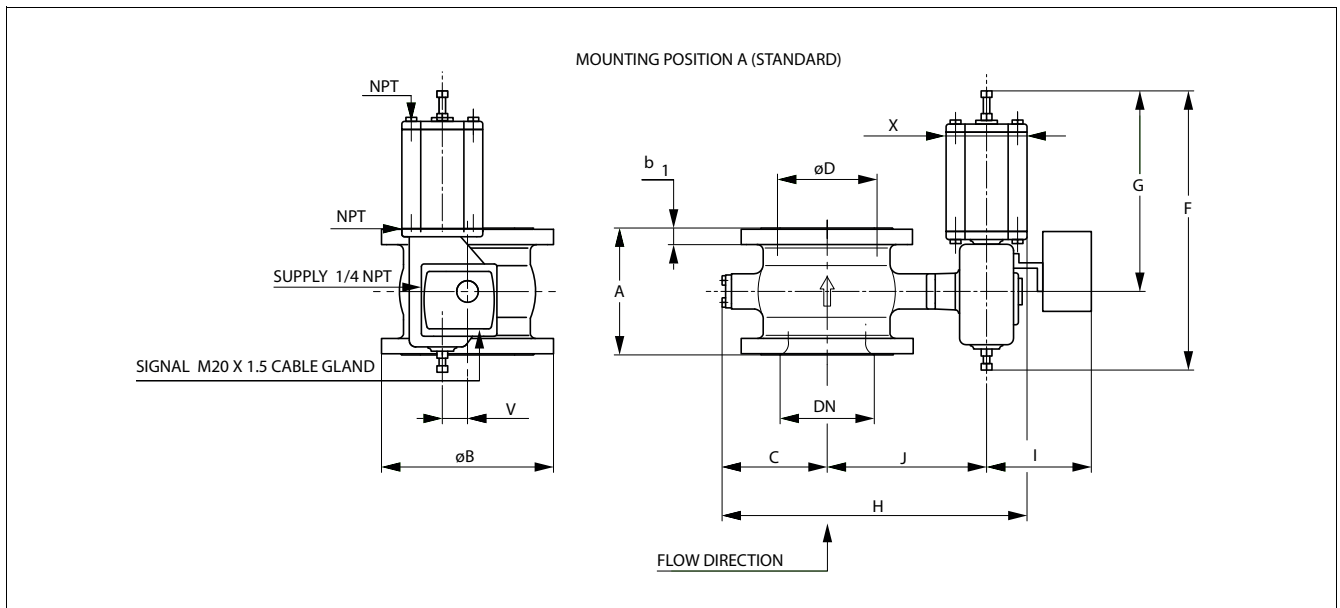


Type	Max Δp ¹⁾	Dimensions, mm													NPT	REJ_PN 10			REK_PN 16			REL_PN 25			REM_PN 40			REC_ASME 150			RED_ASME 300(600)																											
		NPS	DN	A	C	øD	F	G	X	V	J	H	L _{max}	øB		b ₁	kg	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg																										
RE_01-B1C6	50	1	25	102	56	33/38"	400	260	90	36	240	341	310	1/4	115	18	11.9	115	18	11.9	115	18	11.9	115	18	11.9	108	18	11.9	124	18(17.5)	11.9(12.2)																										
RE_1H-B1C6	50	1.5	40	114	65	49	400	260	90	36	247	357	310	1/4	150	18	13.5	150	18	13.5	150	18	13.5	150	18	13.5	127	18	13.5	155	18(23)	14.3(15.3)																										
RE_02-B1C6	50	2	50	124	91	60	400	260	90	36	258	394	310	1/4	165	20	16.1	165	20	16.1	165	20	16.1	165	20	16.1	152	20	16.1	165	20(25.4)	16.8(18.7)																										
RE_2H-B1C6	50	2.5	65	145	97	75	400	260	90	36	265	410	310	1/4	185	22	18	185	22	18	185	22	18	185	22	18	185	22	18	-	-	-																										
RE_03-B1C6	50	3	80	165	108	89	400	260	90	36	290	443	310	1/4	200	20	23	200	20	23	200	24	23	200	24	23	191	24	21	210	24(31.8)	26(29.6)																										
RE_04-B1C6	40	4	100	194	120	113	400	260	90	36	299	464	310	1/4	220	20	25.3	220	20	25.3	235	24	28.3	235	24	28.3	229	24	28.3	254(275)	24(38.1)	34.3(46.7)																										
RE_06-B1C6	10	6	150	229	174	164	400	260	90	36	348	567	310	1/4	285	22	50	285	22	50	300	28	55	62	300	28	55	62	279	28	52	59	46.3																									
RE_06-B1C9	25						315	110	43	349	578	305	1/4	57																				57	300	28	55	62	300	28	55	62	279	28	52	59	46.3											
RE_06-B1C11	40						375	135	65	355	597	310	3/8	57																				57	310	3/8	57	57	310	3/8	57	57	310	3/8	57	57	310	3/8	57	57	310	3/8	57	57	310	3/8		
RE_08-B1C6	4	8	200	243	201	205	400	260	90	36	403	649	310	1/4	340	24	63	340	24	67	360	30	71	77	84	375	34	78	84	91	343	30	69	75	82																							
RE_08-B1C9	15						315	110	43	404	660	305	1/4	70																						70	340	24	73	77	84	375	34	84	91	343	30	75	82	381	34	96	96	103				
RE_08-B1C11	32						375	135	51	410	679	310	3/8	77																						77	340	24	80	80	360	30	84	91	343	30	84	91	343	30	84	91	343	30	84	91	343	30
RE_10-B1C9	7	10	250	297	251	259	455	315	110	43	446	752	310	1/4	405	26	106	405	26	106	425	32	122	137	160	450	38	146	161	184	406	32	114	139	162																							
RE_10-B1C11	15						375	135	51	452	771	310	3/8	121																						121	425	32	137	160	450	38	146	161	184	406	32	114	139	162	450	38	159	174	197			
RE_10-B1C13	29						540	345	115	465	807	325	3/8	144																						144	460	28	144	144	460	28	144	144	460	28	144	144	460	28	144	144	460	28	144	144	460	28
RE_10-B1C17	35						540	375	135	51	482	819	310	3/8																						144	144	460	28	144	144	460	28	144	144	460	28	144	144	460	28	144	144	460	28	144	144	460
RE_12-B1C13	19	12	300	338	269	300	635	445	175	65	498	855	325	3/8	460	26	159	460	28	159	485	34	183	206	520	42	202	217	240	483	34	177	200	520	42																							
RE_12-B1C17	30						770	545	215	78	513	890	340	1/2																						182	182	485	34	206	520	42	202	217	240	483	34	177	200	520	42	219	234	257				
RE_14-B1C13	9						635	445	175	65	514	913	325	3/8																						182	182	485	34	206	520	42	202	217	240	483	34	177	200	520	42	219	234	257				
RE_14-B1C17	21	14	350	400	311	350	770	545	215	78	529	947	340	1/2	505	26	236	520	30	218	555	38	281	580	46	304	321	534	38	261	280	584	46	319																								
RE_14-B1C20	27						840	575	215	97	548	967	355	1/2																					255	255	520	30	218	555	38	281	580	46	304	321	534	38	261	280	584	46	319					
RE_16-B1C17	15	16	400	400	353	400	770	545	215	78	590	1051	340	1/2	565	26	293	580	32	312	620	40	349	660	50	405	424	597	40	323	342	400	648	50	414																							
RE_16-B1C20	21						840	575	215	97	609	1071	355	1/2																						370	370	620	40	349	660	50	405	424	597	40	323	342	400	648	50	414						
RE_16-B1C25	30						1075	725	265	121	632	1118	390	1/2																						370	370	620	40	349	660	50	405	424	597	40	323	342	400	648	50	414						
RE_20-B1C25	16	20	500	508	430	500	1075	725	265	121	723	1286	390	1/2	670	26	547	715	42	566	730	46	661	755	57	552	700	41.3	562	775	64	584																										
RE_24-B1C25	9	19	24	600	610	497	600	1075	725	265	121	842	1498	390	1/2	780	28	1034	840	40	1105	845	46	1165	1290	890	60	1171	1296	815	46.1	1100	1225	915	68.3																							
RE_24-B1C32	19							1370	920	395	153	879	1573	430	3/4																					1159	1159	840	40	1105	845	46	1165	1290	890	60	1171	1296	815	46.1	1100	1225	915	68.3	1298	1423		
RE_28-B1C32	10	28	700	710	547	700	1370	920	395	153	944	1686	430	3/4	895	30	1345	910	42	1386	960	50	1467	995	64	1580	925	69.9	1506	1696	1035	88.9	1770																									
RE_28-B1C40	23						1670	1150	505	194	993	1756	450	3/4																				1535	1535	910	42	1386	960	50	1467	995	64	1580	925	69.9	1506	1696	1035	88.9	1770	1960						

1) Max Δp in on-off service with actuator load factor 0.6 and supply pressure 5 bar

*) 38 mm for low capacity segment eg. C005-RE_

12.7 RE - B1J, B1JA

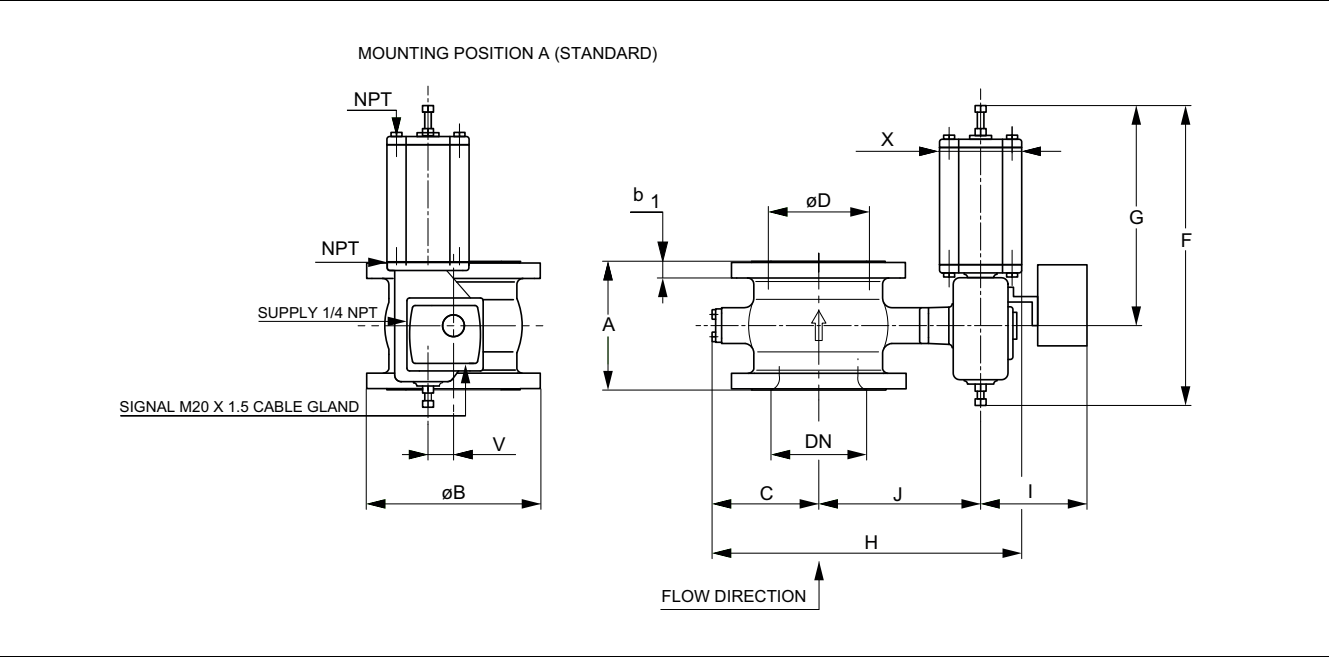


Type	Max Δp ¹⁾	Dimensions, mm											NPT	REJ_PN10			REK_PN16			REL_PN25			REM_PN40			REC_ASME 150			RED_ASME 300(600)			
		NPS	DN	A	C	øD	F	G	X	V	J	H		I _{max}	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg	øB	b ₁	kg
RE_01-B1J6	50/50	1	25	102	56	33/38*	485	368	110	36	238	362	305	3/8	115	18	20	115	18	20	115	18	20	115	18	20	108	18	20	124	18(17.5)	11.9(12.2)
RE_1H-B1J6	50/50	1.5	40	114	65	49	485	368	110	36	245	378	305	3/8	150	18	22	150	18	22	150	18	22	150	18	22	127	18	22	155	18(23)	14.3(15.3)
RE_02-B1J6	50/50	2	50	124	91	60	485	368	110	36	256	414	305	3/8	165	20	24	165	20	24	165	20	24	165	20	24	152	20	24	165	20(25.4)	16.8(18.7)
RE_2H-B1J6	50/50	2.5	65	145	97	75	485	368	110	36	263	428	305	3/8	185	22	25	185	22	25	185	22	25	185	22	25	185	22	25	-	-	-
RE_03-B1J6	50/50	3	80	165	108	89	485	368	110	36	288	464	305	3/8	200	20	31	200	20	31	200	24	31	200	24	31	191	24	29	210	24(31.8)	34(37.6)
RE_04-B1J6	50/50	4	100	194	120	113	485	368	110	36	297	485	305	3/8	220	20	33	220	20	33	235	24	36	235	24	36	229	24	37	254(275)	24(38.1)	42(52.4)
RE_01-B1J8/B1JA8	50/50	1	25	102	56	33/38*	560	420	135	43	240	364	305	3/8	115	18	25	115	18	25	115	18	25	115	18	25	108	18	25	124	18	25
RE_1H-B1J8/B1JA8	50/50	1.5	40	114	65	49	560	420	135	43	247	380	305	3/8	150	18	27	150	18	27	150	18	27	150	18	27	127	18	27	155	18	28
RE_02-B1J8/B1JA8	50/50	2	50	124	91	60	560	420	135	43	258	416	305	3/8	165	20	29	165	20	29	165	20	29	165	20	29	152	20	29	165	20	30
RE_2H-B1J8/B1JA8	50/50	2.5	65	145	97	75	560	420	135	43	265	430	305	3/8	185	22	30	185	22	30	185	22	30	185	22	30	185	22	30	-	-	-
RE_03-B1J8/B1JA8	50/50	3	80	165	108	89	560	420	135	43	290	466	305	3/8	200	20	36	200	20	36	200	24	36	200	24	36	191	24	34	210	24	39
RE_04-B1J8/B1JA8	50/50	4	100	194	120	113	560	420	135	43	299	487	305	3/8	220	20	38	220	20	38	235	24	41	235	24	41	229	24	42	254	24	47
RE_06-B1J8/B1JA8	10/25	6	150	229	174	164	560	420	135	43	348	590	305	3/8	285	22	57	285	22	57	300	28	62	300	28	62	279	28	59	318	28	65
RE_06-B1J10/B1JA10	40/40						650	490	175	51	355	617	225	3/8			70			70												77
RE_08-B1J8/B1JA8	- /12						560	420	135	43	404	673	305	3/8			76			80			84			91			82			103
RE_08-B1J10/B1JA10	15/25	8	200	243	201	205	650	490	175	51	410	700	310	3/8	340	24	90	340	24	93	360	30	84	375	34	91	343	30	95	381	34	116
RE_08-B1J12/B1JA12	32/35						800	620	215	65	426	736	235	1/2			118			120			124			132			123			144
RE_10-B1J10/B1JA10	5/15						650	490	175	51	452	790	310	3/8			119			119			135			159			124			172
RE_10-B1J12/B1JA12	20/25	10	250	297	251	259	800	620	215	65	468	827	325	1/2	405	26	147	405	26	147	425	32	135	450	38	187	406	32	145	450	38	200
RE_10-B1J16/B1JA16	35/35						990	760	265	78	483	867	340	1/2			200			200			216			240			218			253
RE_12-B1J12/B1JA12	8/18						800	620	215	65	498	875	325	1/2			185			185			209			243			203			260
RE_12-B1J16/B1JA16	20/25	12	300	338	269	300	990	760	265	78	513	916	340	1/2	460	26	228	460	28	228	485	34	252	520	42	217	483	34	246	520	42	303
RE_12-B1J20/B1JA20	30/30						1200	935	395	97	534	1000	270	3/4			303			303			327			361			321			378
RE_14-B1J16/B1JA16	11/22						990	760	265	78	529	973	340	1/2	505	26	282	520	30	287	555	38	327	580	46	370	534	38	307	584	46	388
RE_14-B1J20/B1JA20	30/30	14	350	400	311	350	1200	935	395	97	548	1057	355	3/4			357			362			402			445			382			463
RE_16-B1J20/B1JA20	19/25						1200	935	395	97	609	1161	355	3/4	565	26	414	580	32	419	595	40	470	646	50	526	597	40	444	620	50	535
RE_16-B1J25/B1JA25	30/30	16	400	400	353	400	1200	1200	505	121	632	1238	390	3/4			590			620			646			702			620			711
RE_20-B1J25/B1JA25	25/25	20	500	508	430	500	1530	1200	505	121	723	1406	390	1/2	670	47	720	715	47	720	730	47	825	755	57	596	699	47	720	775	62	828
RE_24-B1J32/B1JA32	18/18	24	600	610	497	600	1885	1435	540	153	879	1577	427	1	780	28	1574	840	40	1645	845	46	1705	890	60	1711	815	46.1	1640	915	68.3	1838
RE_28-B1J32/B1JA32	13/13	28	700	710	547	700	1885	1435	540	153	943	1691	427	1	895	30	1760	910	42	1801	960	50	1882	995	64	1995	925	69.9	1921	1035	88.9	2185

1) Supply pressure BJ 4 bar / BJA 5 bar

*) 38 mm for low capacity segment eg. C005-RE_

12.8 RE - QPX

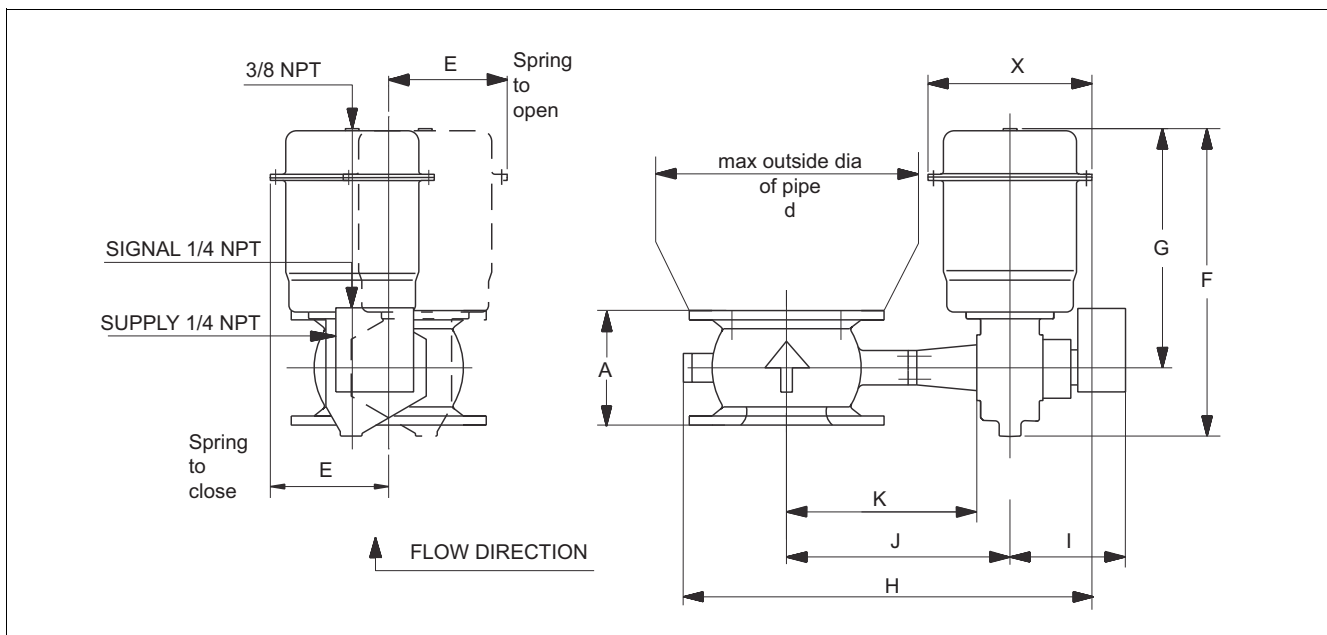

DN	Actuator QPX	Max shut-off Δp bar RE, Q-RE	Max control Δp bar RE	Max control Δp bar Q-RE	Dimensions, mm										Total weight, kg	
					A	E	F	G	H	I	J	K	X	Pipe d	ASME 150	ASME 300(600)
25	1	50	35	-	102	142	382	330	388	160	225	182	213	230	19	20.5(20.8)
40	1	50	35	-	114	142	382	330	404	160	232	189	213	245	20	23(24)
50	1	50	35	35	124	142	382	330	441	160	243	200	213	265	22	25(26.9)
80	2	35	25	18	165	142	382	330	506	172	284	232	213	330	38	43(46.6)
100	2	35	25	18	194	156	480	389	527	172	293	241	228	350	45	53(65.4)
150	2	28	25	18	229	156	480	389	630	191	342	290	228	450	63	78
	3	40	25	18	229	190	565	446	657	214	346	290	274	410	78	93
200	3	16	16	15	243	190	565	446	739	191	401	345	274	520	101	122
	4	35	25	15	243	228	635	495	768	214	407	345	320	485	121	142
250	4	20	20	10	297	228	635	495	860	214	449	387	320	570	150	198
	5	35	20	10	297	276	768	608	906	243	464	387	382	540	205	253
300	5	25	10	8	338	276	768	608	982	214	522	445	382	650	256	313
350	5	12	10	8	400	276	768	608	1065	243	563	486	382	735	317	398
400	5	8	8	8	400	276	768	608	1174	243	630	553	382	870	378	470

12.9 Suitability with different flanges, RA and RE1 valves

Flange	Valve size								
	DN 25 / 01	DN 40 / 01H	DN 50 / 02	DN 65	DN 80 / 03	DN 100 / 04	DN 150 / 06	DN 200 / 08	DN 250
ASME B16.5 Class 150	x	x	x	x	x	x	x	x	x
ASME B16.5 Class 300	x	x	x	x	x	x	x	x	-
PN 40	x	x	x	x	x	x	x	-	x
PN 25	x	x	x	x	x	x	x	x	x
PN 16	x	x	x	x	x	x	x	x	x
PN 10	x	x	x	x	x	x	x	x	x
ISO 7005 PN 20	x	x	x	x	x	x	x	x	x
ISO 7005 PN 50	x	x	x	x	x	x	x	x	-
JIS 2238 10K	x	x	x	x	x	x	x	x	x
JIS 2238 16K	x	x	x	x	x	x	x	x	x
JIS 2238 20K	x	x	x	x	x	x	x	x	x
JIS 2238 30K	x	x	x	x	x	x	x	x	x

x = suitable with this flange

- = not suitable with this flange

12.10 Flange ratings, RE (Class 150, 300)

Size	PN 10	PN 16	PN 25	PN 40
025*	equal to PN 40	equal to PN 40	equal to PN 40	M
040*	equal to PN 40	equal to PN 40	equal to PN 40	M
050*	equal to PN 40	equal to PN 40	equal to PN 40	M
065	equal to PN 16	K	equal to PN 40	M
080*	equal to PN 40	equal to PN 40	equal to PN 40	M
100*	equal to PN 16	K	equal to PN 40	M
150*	equal to PN 16	K	equal to PN 40	M
200	J	K	L	M
250	J	K	L	M
300	J	K	L	M
350	J	K	L	M
400	J	K	L	M
500	J	K	L	M
600	J	K	L	M
700	J	K	L	-
800	J	K	L	-

Note: Class 600 RE with full rated valve body.

13 TYPE CODE

13.1 Series RA

V-port segment valve, series RA						
1.	2.	3.	4.	5.	6.	7.
	RA	A	100	A	S	—

1.	C _V -CODE FOR VALVE SIZE DN 25 (01")
STANDARD CV	
	Without sign
Q-TRIM	
Q	Low noise and anti-cavitation trim
NON-STANDARD CV	
C005-	Max. C _v = 0.5
C015-	Max. C _v = 1.5
C05-	Max. C _v = 5.0
C15-	Max. C _v = 15.0

2.	PRODUCT SERIES / DESIGN
RA	Wafer, reduced bore, Neles face-to-face lenght, body PN 40* / ASME Class 300**.
* DN 250 body only acc. to EN PN 40.	
**Max. shut-off pressure for trim, see Table 1.	

3.	CONSTRUCTION
A	Standard, drive shaft with keyway
Y	Special

4.	SIZE
	In millimetres: 025, 040, 050, 065, 080, 100, 150, 200, 250

5.	BODY	SEGMENT	SCREWS	SHAFT, PINS / BEARINGS
A	CF8M	AISI 329 + HCr	A2-70	AISI 329 / PTFE
C	CG8M	AISI 329 + HCr	A2-70	AISI 329 / PTFE
H (with T6 seat)	CW-6M (Hastelloy C)	CW-6M	A2-70	Hastelloy C / PVDF
S (with T2 seat)	CF8M	AISI 329	A2-70	AISI 329 / PTFE
U (with U seat)	CK3MCuN (SMO)	ASTM A351 gr. CK3MCuN + ceramic coating (TiO)	A2-70	UNS31254 / filled PTFE on SMO 254 net
Seals for above:		Gland packing: Blind flange:	PTFE V-ring type PTFE	
Y	Special			

Low Cv + metal seat: segment material AISI 316 + HCr.
Low Cv + soft seat: segment material AISI 316 (without HCr).

6.	SEAT MATERIAL AND CONSTRUCTION
S	Stainless steel + Cobalt Hard facing, -40 °C to +260 °C. 1-way tight metal seat, for NPS 1" - 10" / DN 25 - 250
1S	Stainless steel + Cobalt Hard facing, -30 °C to +200 °C. 2-way tight metal seat, for NPS 1" - 10" / DN 25 - 250.
T2	Stainless steel with PTFE+C25, -40 °C to +260 °C.
T6	Hastelloy with Xtreme insert, -40 °C to +120 °C.
E	Cobalt based alloy, -50 °C to +260 °C. Non-tight, extremely erosive services.
U	Titanium, -40 °C to +120 °C.

7.	FLANGE FACING
STANDARD	
	Without sign: EN1092-1 Type B1 (Ra 3.2 ... 12.5) Covers: DIN2526 form C DIN2526 form D Raised face stock finished (Ra10...12.5)
NON-STANDARD	
/Y	Special

13.2 Series RE, RE1

V-port segment valve, series RE and RE1												
1.	2.	3.	4.	5.	6.	7.	8.	9.	10.	11.		12.
Q-	RE	D	A	03	D	J	J	S	T	A	/	-

1.	C _V -CODE	
	Standard V-port (without sign)	
Q-	Q-trim, low noise and anti-cavitation trim. (for DN 50 / 2" and bigger)	
C005-	Max. C _v = 0.5 (for DN 25 / 1" only)	(Not with 1S-seat)
C015-	Max. C _v = 1.5 (for DN 25 / 1" only)	
C05-	Max. C _v = 5 (for DN 25 / 1" only)	
C15-	Max. C _v = 15 (for DN 25 / 1" only)	

2.	PRODUCT SERIES / DESIGN
RE	Flanged, one piece body, V-port segmented ball, face-to-face acc. to ISA S75.04 and IEC Part 3-2. Inch threads.
RE1	Flangeless one piece body, V-port segmented ball, face-to-face acc. to ISA S75.04 and IEC 534 Part 3-2.
RE13	Flanged body, V-port segmented ball face-to-face acc. to ASME B16.10 (spool piece constr.).

3.	PRESSURE RATING	Size range
C	ASME 150	NPS 1" - 32"
D	ASME 300	NPS 1" - 32"
F	ASME 600	NPS 1" - 4"
J	PN 10	DN 200 - DN 800
K	PN 16	DN 50 - DN 800
L	PN 25	DN 200 - DN 800
M	PN 40	DN 25 - DN 600
R	JIS 10K flanges, based on body casting of ASME 150	DN 25 - DN 800
S	JIS 16K flanges, based on body casting of ASME 300	DN 25 - DN 800
T	JIS 20K flanges, based on body casting of ASME 300	DN 25 - DN 800
Y	Special, to be specified	-

4.	CONSTRUCTION
A	Standard, (2-way tight with 1S-seat)
B	Low emission construction (ISO 15848-1; Class BH, CC-3 / temp: 260 °C, Class BH CC-2 / temp: 400 °C)
E	Drive shaft with splines to actuator
U	Protected bearings (Viton GF O- rings) (*)
V	Hydrogen Peroxide (H2O2) construction.
X	Antistatic device (*)
S	Steam jacket (for DN 25 - 50 / NPS 1" - 2") consult the factory.
Z	Oxygen construction, only for Gaseous Oxygen Service. - BAM listed non-metallic materials - Temperature: +200 °C to -50 °C - Cleaning acc. to Neles internal procedure Recommended type code: RE_Z_AJJSJG
Y	Special, to be specified

5.	SIZE	
	ASME	EN
01	ASME flanged, 150, 300 and 600	025 EN flanged, PN 40
1H	ASME flanged, 150, 300 and 600	040 EN flanged, PN 40
02	ASME flanged, 150, 300 and 600	050 EN flanged, PN 40
2H	ASME flanged, 150 and 300	065 EN flanged, PN16, 40
03	ASME flanged, 150, 300 and 600	080 EN flanged, PN 40
04	ASME flanged, 150, 300 and 600	100 EN flanged, PN 16, 40
06	ASME flanged, 150 and 300	150 EN flanged, PN 16, 40
08	ASME flanged, 150 and 300	200 EN flanged, PN 10, 16, 25, 40
10	ASME flanged, 150 and 300	250 EN flanged, PN 10, 16, 25, 40
12	ASME flanged, 150 and 300	300 EN flanged, PN 10, 16, 25, 40
14	ASME flanged, 150 and 300	350 EN flanged, PN 10, 16, 25, 40
16	ASME flanged, 150 and 300	400 EN flanged, PN 10, 16, 25, 40
20	ASME flanged, 150 and 300	500 EN flanged, PN 10, 16, 25, 40
24	ASME flanged, 150 and 300	600 EN flanged, PN 10, 16, 25, 40
28	ASME flanged, 150 and 300	700 EN flanged, PN 10, 16, 25
32	ASME flanged, 150 and 300	800 EN flanged, PN 10, 16, 25

6.	BODY MATERIALS
	STANDARD
D	ASTM A216 gr. WCB / 1-0619
A	ASTM A351 gr. CF8M / 1.4408
C	ASTM A351 gr. CG8M (for DN 25 - DN 500 / 1" - 20")
	NON STANDARD
H	H ASTM A494 gr. CW-6M (Hastelloy C)
U	ASTM A351 gr. CK3MCuN (SMO)
F	ASTM A352 gr. LCC
Y	Special

7.	SEGMENT MATERIALS
	STANDARD
J	Type AISI 329 + HCr, with seat S
S	AISI 329, with seat T2
	NON STANDARD
H	ASTM A494 gr. CW-6M (Hastelloy C), with seat T6.
U	ASTM A351 gr. CK3MCuN (SMO) + ceramic (TiO), with seat U.
T	Titanium + ceramic coating
Y	Special

8.	SHAFT AND PIN MATERIALS	BEARING MATERIALS
STANDARD		
J	Type AISI 329	Filled PTFE on SS 316 net, max +260 °C
NON STANDARD		
H	Hastelloy C	PVDF, max +120 °C
U	UNS31254	Filled PTFE on Inconel 625 net, max +260 °C
N	Nitronic 50 (XM-19)	Filled PTFE on SS 316 net, max +260 °C
S	17-4 PH	Cobalt based alloy, max +425 °C
V	Type AISI 329	Virgin PTFE on SS 316 net, max +260 °C
U	17-4 PH	Filled PTFE on SS 316 net, max +260 °C
Y	Special	

9.	SEAT DESIGN AND MATERIALS
STANDARD	
S	Stainless steel + Cobalt Hard facing, -50 °C to +260 °C. 1-way tight metal seat, For NPS 1" - 20" / DN 25 - 500
NON STANDARD	
1S	Stainless steel + Cobalt Hard facing, -30 °C to +200 °C. 2-way tight metal seat, For NPS 1" - 32" / DN 25 - 800.
U	Titanium, -50 °C to +260 °C.
T2	Stainless steel with Xtreme insert, -40 °C to +260 °C.
T6	Hastelloy with Xtreme insert, -50 °C to +120 °C.
E	Cobalt based alloy, -50 °C to +260 °C. Non-tight, extremely erosive services.
E1	Non tight metal seat for extremely erosive applications
A, A1	High temp. metal seat, -50 °C to +425 °C. ANSI cl. IV.
O	No seat
Y	Special

10.	STEM PACKING	BLIND FLANGE SEAL
STANDARD		
T	PTFE V- rings, live loaded	PTFE Max +260 °C
G	Graphite rings, live loaded	Graphite Max +425 °C (Fire-safe)
NON STANDARD		
	PTFE V- rings, without live loading	PTFE Max +260 °C
	Graphite rings, without live loading	Graphite Max +425 °C

11.	MODEL CODE
-	Version 0
A	Version A is used only with NPS02, NPS03-10 / DN50, DN80-DN250

12.	FLANGE FACING
-	EN 1092-1 Type B1 (Ra3.2-12.5) Covering: ASME B16.5 Ra 3.2 – 6.3
02	Raised face Ra 10 - 12.5

Valmet Flow Control Oy

Vanha Porvoontie 229, 01380 Vantaa, Finland.

Tel. +358 10 417 5000.

www.valmet.com/flowcontrol

Subject to change without prior notice.

Neles, Neles Easyflow, Jamesbury, Stonel, Valvcon and Flowrox, and certain other trademarks, are either registered trademarks or trademarks of Valmet Oyj or its subsidiaries in the United States and/or in other countries.

For more information www.neles.com/trademarks

